

NOTFORCOMSTRUCT


REVIEW

NOTES:

- 1. ALL ACCESSIBLE WALKWAYS, RAMPS, PARKING SPACES, AISLES, CROSSWALKS, AND SIGNAGE SHALL MEET THE REQUIREMENTS OF THE TEXAS ACCESSIBILTY STANDAARDS.
- 2. MAXIMUM ALLOWABLE SLOPE IN ANY DIRECTION IN AAREAS OF ACCESSIBLE PARKING SPACES AND AISLES IS TWO (2)

ACCESSIBLE PARKING SPACE STRIPING & SIGNAGE DETAIL

SCALE: 1" = 20'

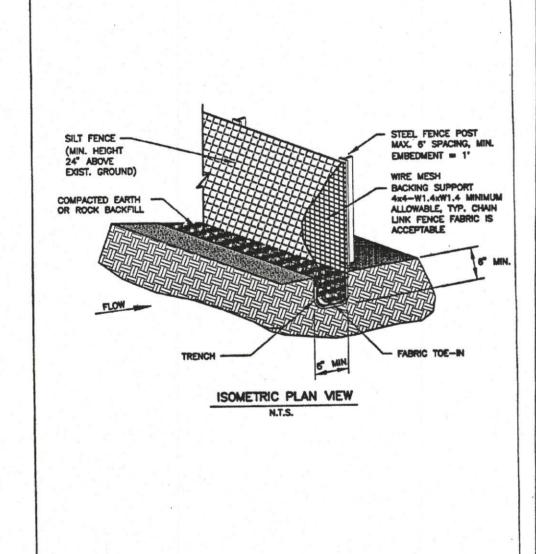

JAN. '98 1020A

SILT FENCE

SILT FENCE GENERAL NOTES:

1. STEEL POSTS WHICH SUPPORT THE SILT FENCE SHALL BE INSTALLED ON A SLIGHT ANGLE TOWARD THE ANTICIPATED RUNOFF SOURCE. POST MUST BE EMBEDDED A MINIMUM OF ONE FOOT

ACCESSIBLE PARKING SIGN

2. THE TOE OF THE SILT FENCE SHALL BE TRENCHED IN WITH A SPADE OR MECHANICAL TRENCHER, SO THAT THE DOWNSLOPE FACE OF THE TRENCH IS FLAT AND PERPENDICULAR TO THE LINE OF FLOW. WHERE FENCE CANNOT BE TRENCHED IN (e.g. PAVEMENT), WEIGHT FABRIC FLAP WITH ROCK ON UPHILL SIDE TO PREVENT FLOW FROM SEEPING UNDER

3. THE TRENCH MUST BE A MINIMUM OF 6 INCHES DEEP AND 6 INCHES WIDE TO ALLOW FOR THE SILT FENCE FABRIC TO BE LAID IN THE GROUND AND BACKFILLED WITH COMPACTED

4. SILT FENCE SHOULD BE SECURELY FASTENED TO EACH STEEL SUPPORT POST OR TO WOVEN WIRE, WHICH IN TURN IS ATTACHED TO THE STEEL FENCE POST. THERE SHALL BE A 3 FOOT OVERLAP, SECURELY FASTENED WHERE ENDS OF FABRIC

5. INSPECTION SHALL BE MADE EVERY TWO WEEKS AND AFTER EACH 1/2" RAINFALL. REPAIR OR REPLACEMENT SHALL BE MADE PROMPTLY AS NEEDED.

6. SILT FENCE SHALL BE REMOVED WHEN THE SITE IS COMPLETELY STABILIZED SO AS NOT TO BLOCK OR IMPEDE STORM FLOW OR DRAINAGE.

7. ACCUMULATED SILT SHALL BE REMOVED WHEN IT REACHES A DEPTH OF HALF THE HEIGHT OF THE FENCE. THE SILT SHALL BE DISPOSED OF AT AN APPROVED SITE AND IN SUCH A MANNER AS TO NOT CONTRIBUTE TO ADDITIONAL SILTATION.

SILT FENCE

RETA CONTROL | STANDARD SPECIFICATION REPERIORS

JAN. 98 10208


FIRE LANE DESIGN GUIDELINES

Minimum width 24! Minimum vertical clearance 14'.


Emergency vehicle turn-arounds must have a minimum diameter of 100'.

Fire Lanes must extend to within 150' of all portions of the exterior walls of the first story.


Fire Lane lettering to be placed on vertical surface of curb where curbs are present

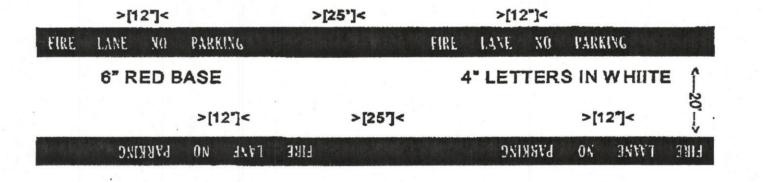



FIRE LANE DESIGN

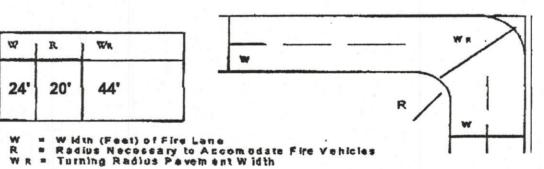



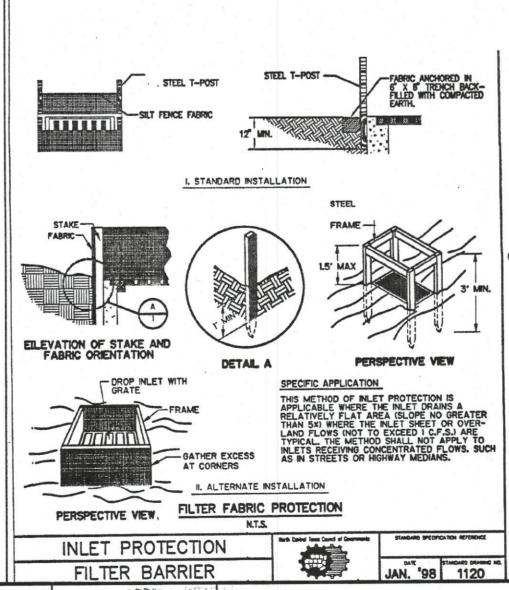


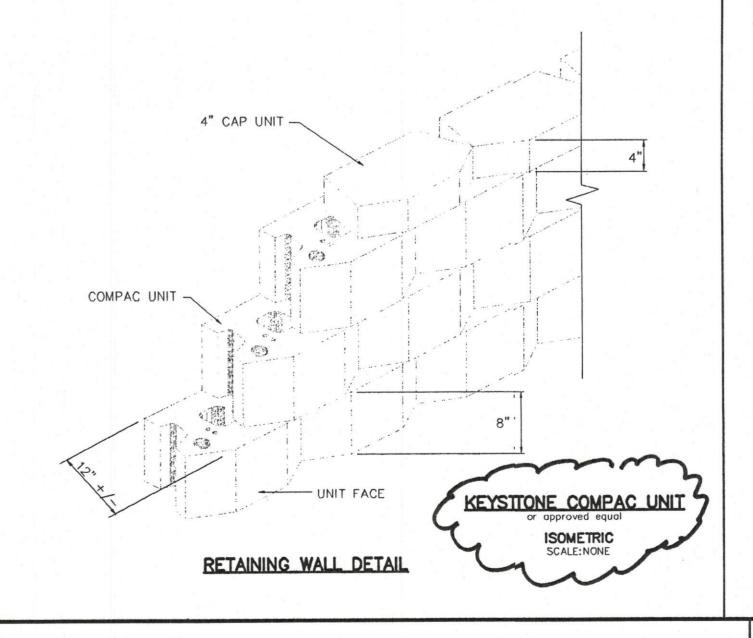


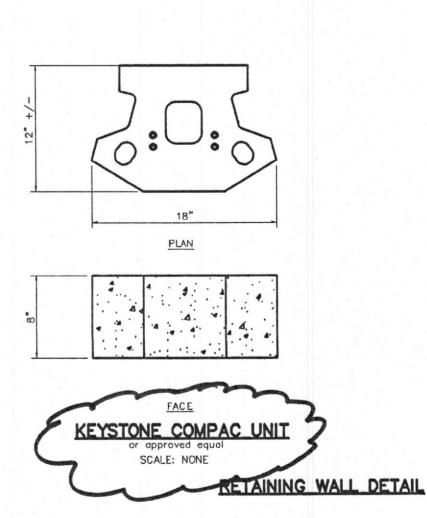

			ONE CALLS
	-		THE ONE CALLS
			1860
			TE.
			Salar Ser
			CALL BEFORE
DATE	BY	DESCRIPTION	OCTOR



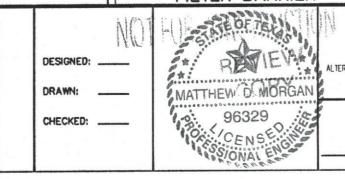

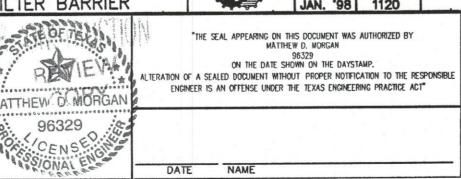



PBA WEST RETAIL BUILDING

ROCKWALL CROSSING

C9.0

DETAILS

OF 9 SHEETS