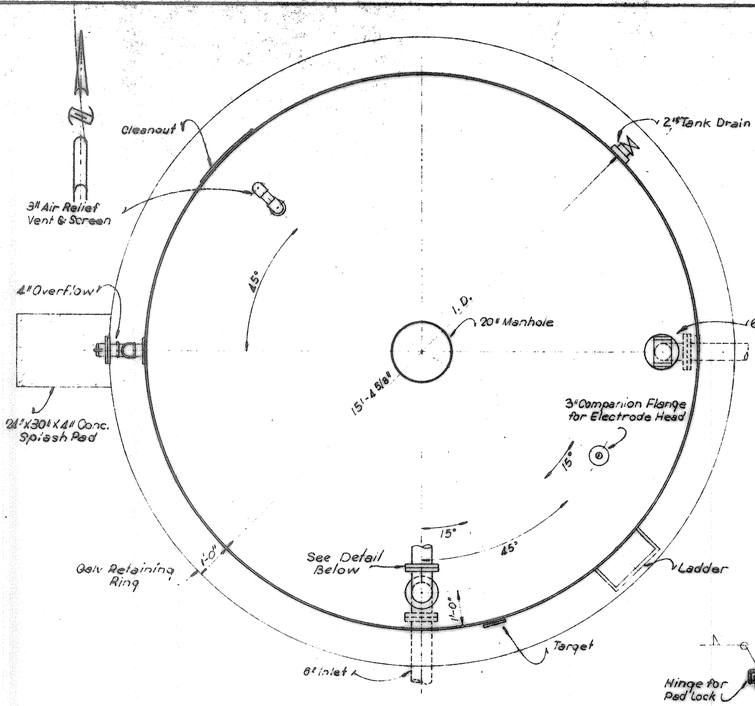

PLAN
STORAGE TANK Nº 1

500 BARRELS

SCALE: 1/2" = 1'-0"

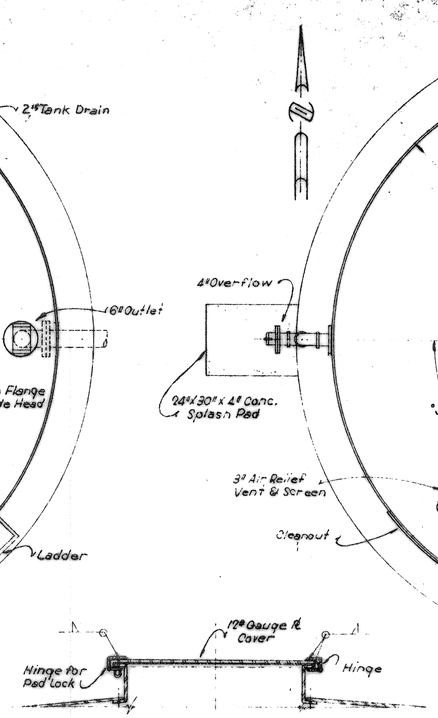

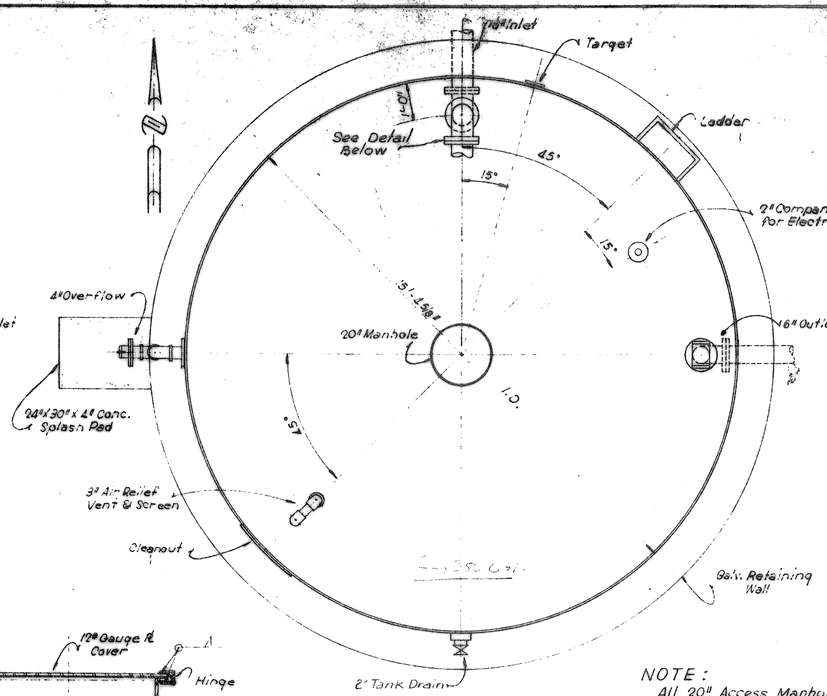

PLAN
STORAGE TANK Nº 3

500 BARRELS

SCALE: 1/2" = 1'-0"

NOTE:
All 20" Access Manholes shall have Overhanging Hinged Covers with Locking Device meeting Texas State Health Department Requirements

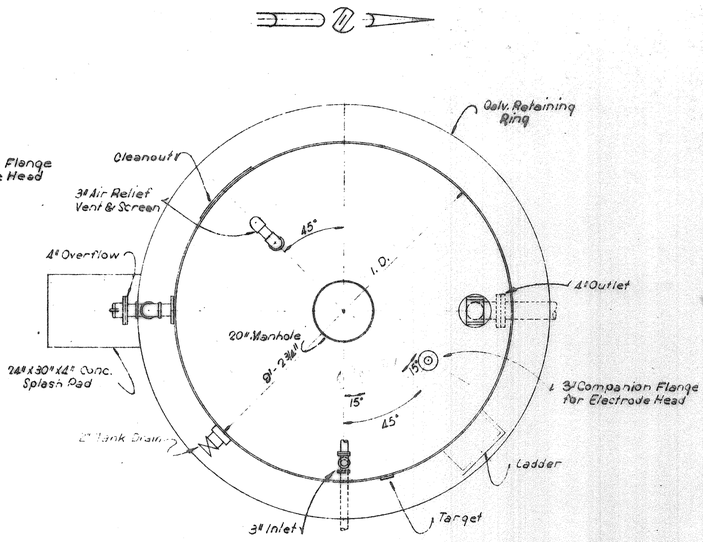

PLAN
STORAGE TANK Nº 2

200 BARRELS

SCALE: 1/2" = 1'-0"

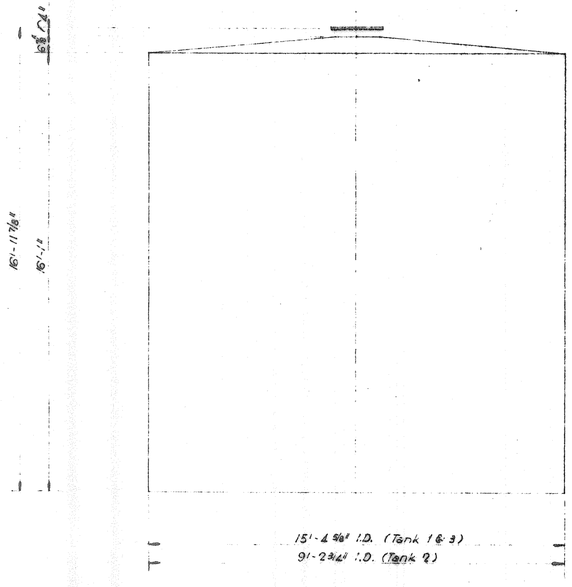

ELEVATION - STORAGE TANK

NO SCALE

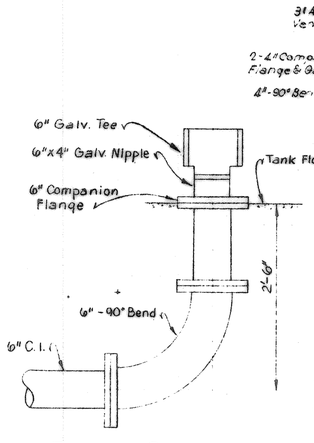

TYPICAL OUTLET DETAIL

NO SCALE

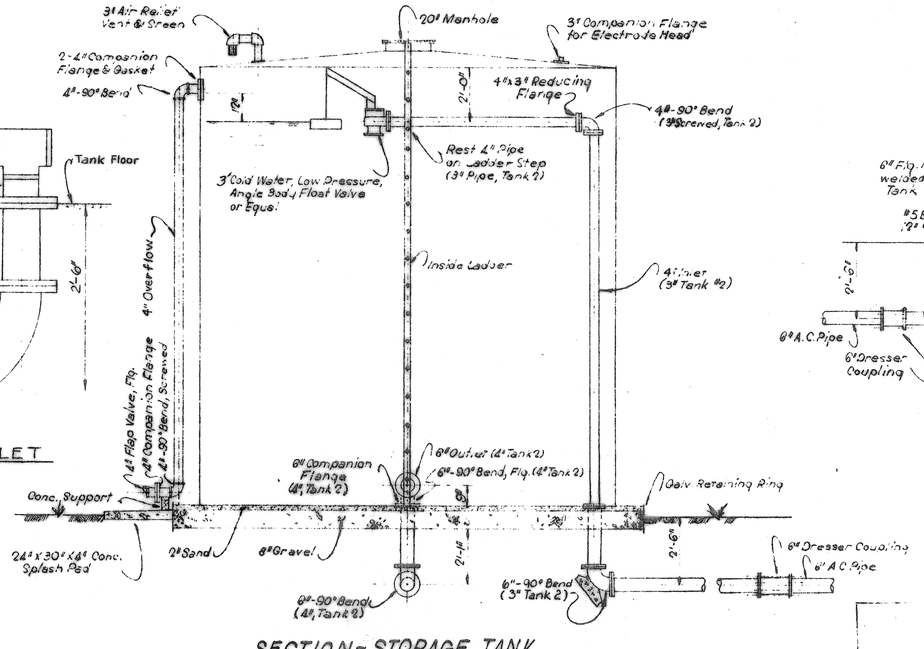

SECTION - STORAGE TANK

SCALE: 3/8" = 1'-0"

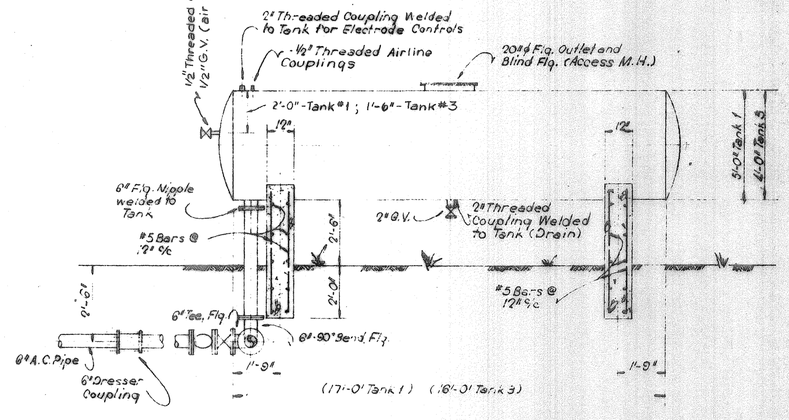

ELEVATION - PRESSURE TANK

SCALE: 3/8" = 1'-0"

JANUARY, 1968

STATE OF TEXAS — ROBERT L. NICHOLS — 10061 — REGISTERED — PROFESSIONAL ENGINEER

BLACKLAND WATER SUPPLY CORP.
ROCKWALL COUNTY, TEXAS

WATER DISTRIBUTION SYSTEM

TANK DETAILS

DESIGNED:	D.L.D.
DRAWN:	C.D.G.
TRACED:	C.D.G.
CHECKED:	R.L.N.

FREESE, NICHOLS & ENDRESS
CONSULTING ENGINEERS
FORT WORTH, TEXAS

DATE: Feb. 1966
SCALE: 1" = 100'
Sheet No. 21 of 22