


DATE: SEPTEMBER 12, 2002
 DRAWN BY: TJC
 CHECKED: RAH
 CWM NO: 144101044
 REVISED:

16" & 20" WATER LINE CONSTRUCTION
ROCKWALL INDEPENDENT SCHOOL DISTRICT
ROCKWALL, TEXAS


FINAL PLANS FOR BIDDING AND CONSTRUCTION




SHEET NUMBER: C
 OF: 2.09
 SET NUMBER:

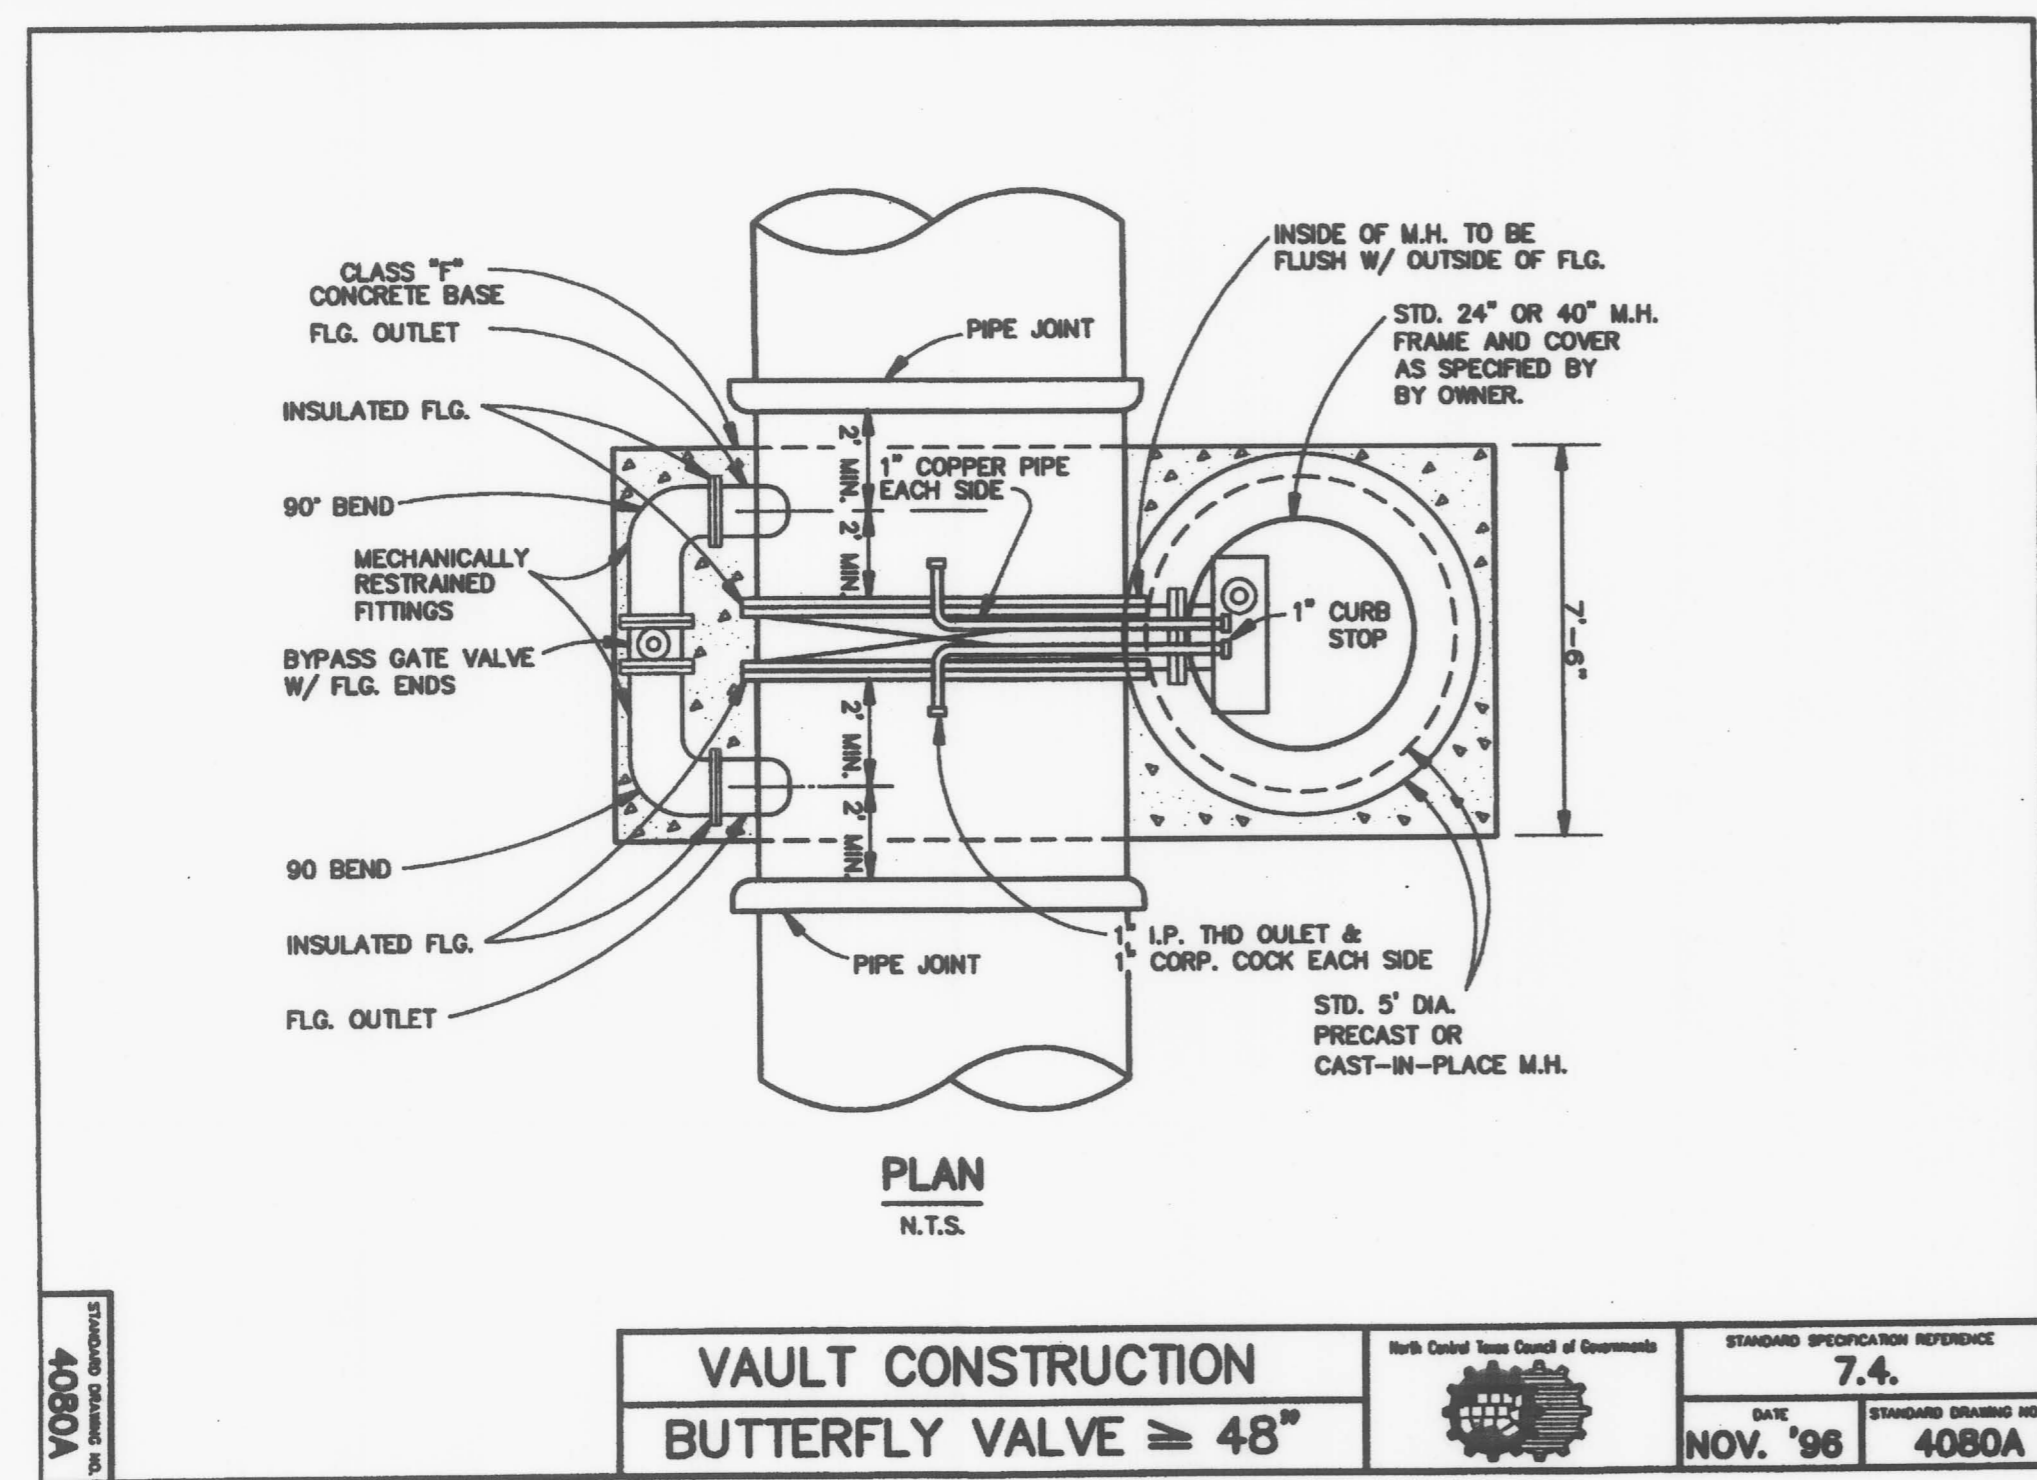


Vault Construction
BUTTERFLY VALVE ≥ 48"
 STANDARD SPECIFICATION REFERENCE: 7.4
 DATE: NOV. '96
 STANDARD DRAWING NO: 4080A

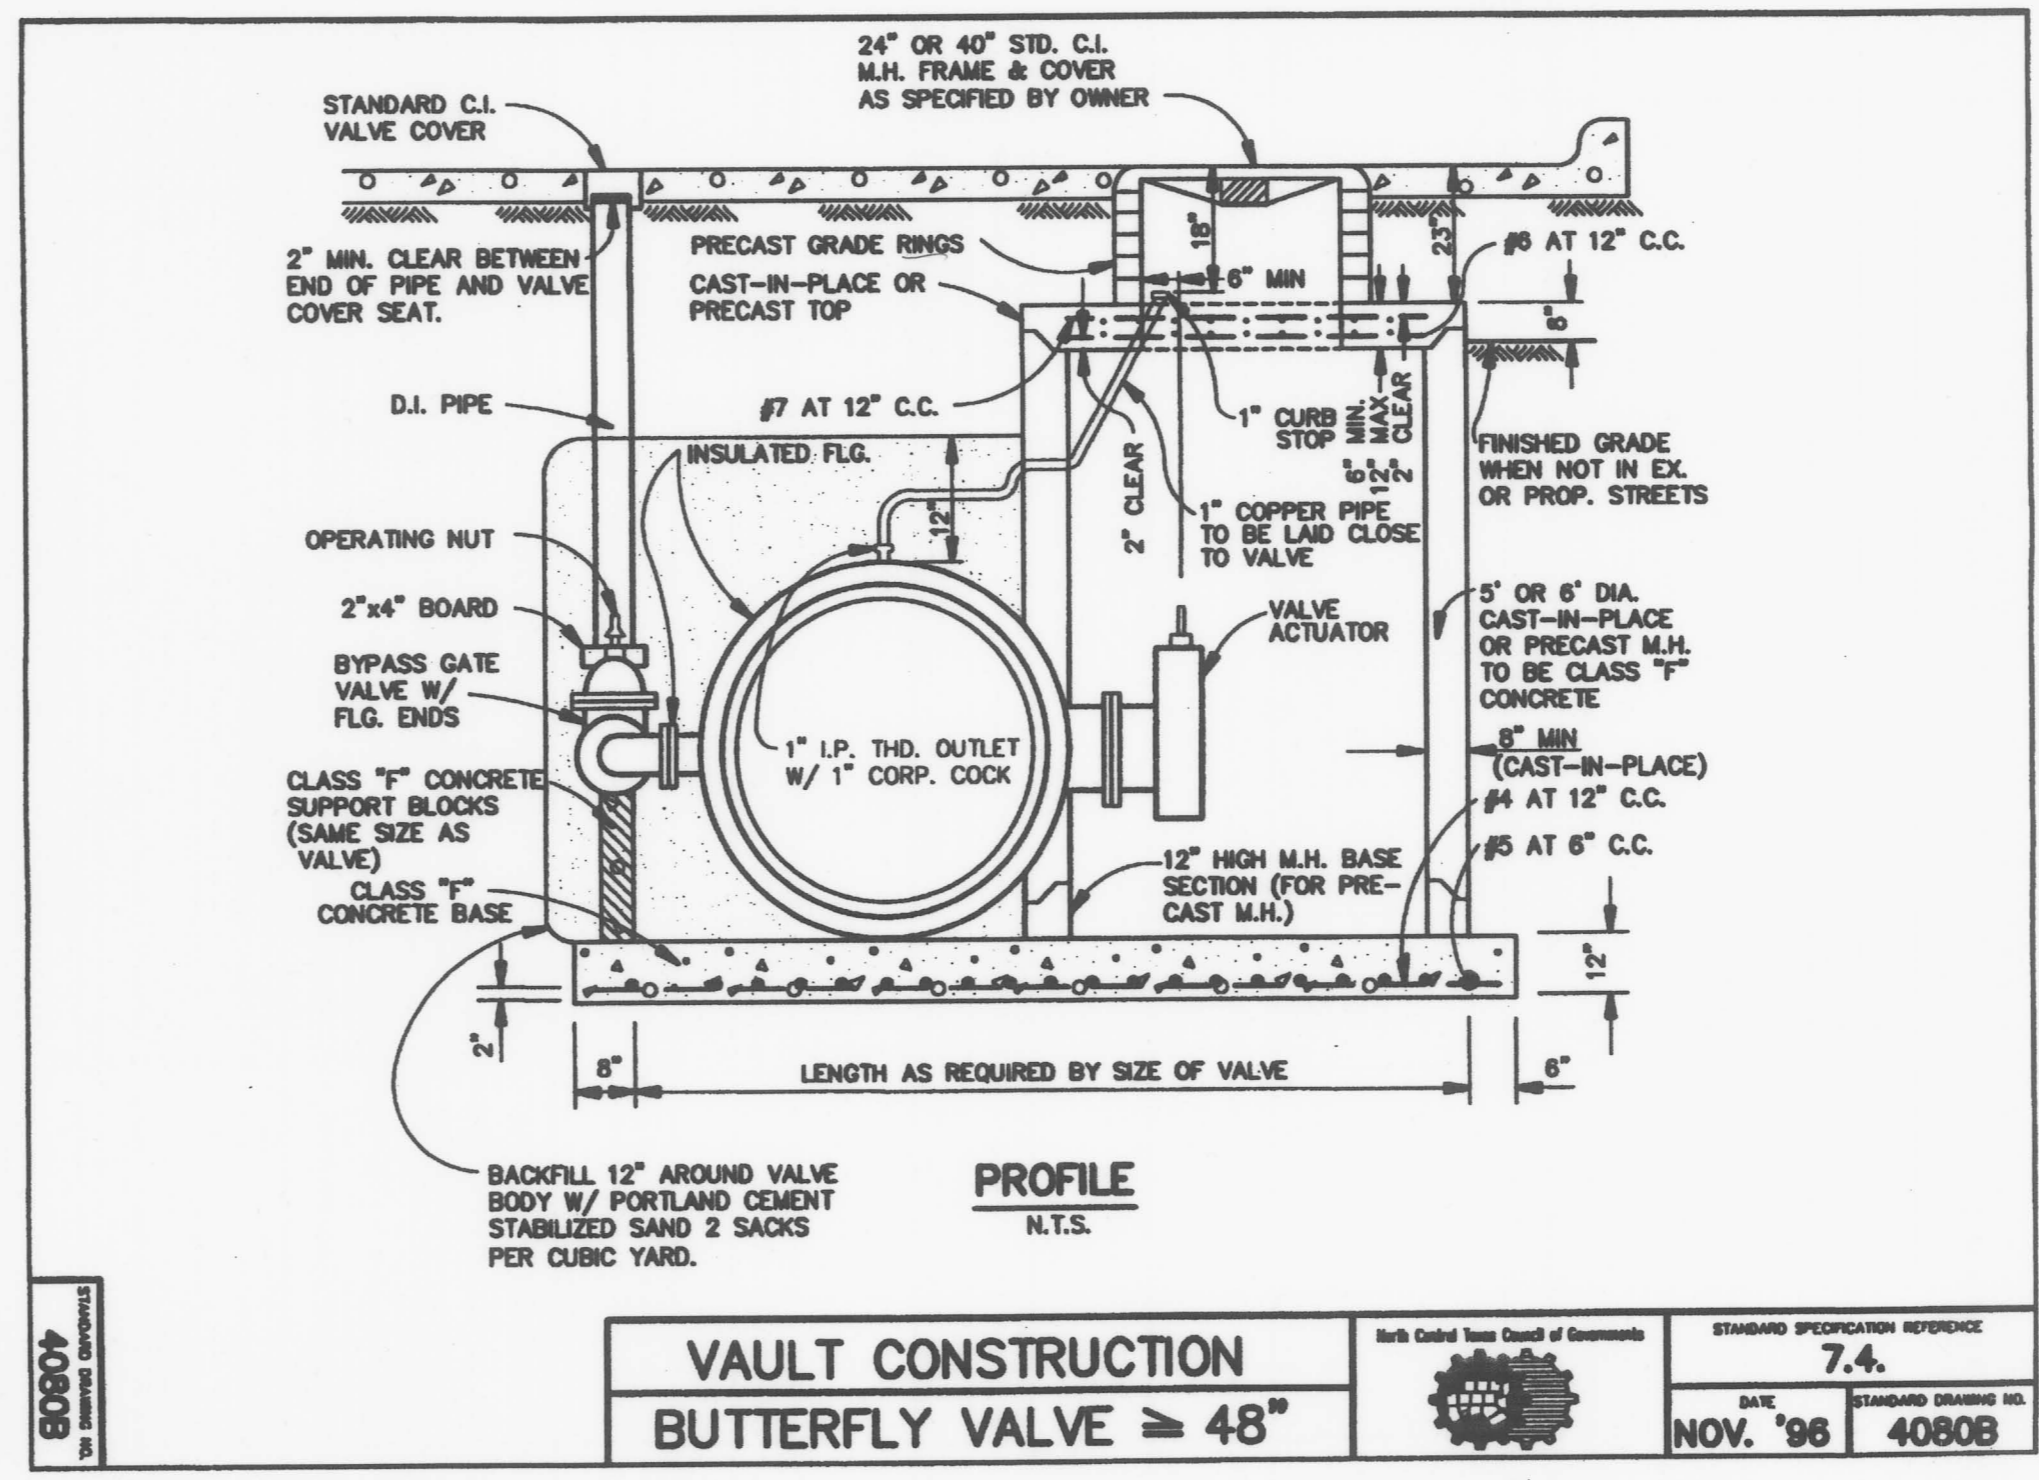

Vault Construction
BUTTERFLY VALVE ≥ 48"
 STANDARD SPECIFICATION REFERENCE: 7.4
 DATE: NOV. '96
 STANDARD DRAWING NO: 4080B

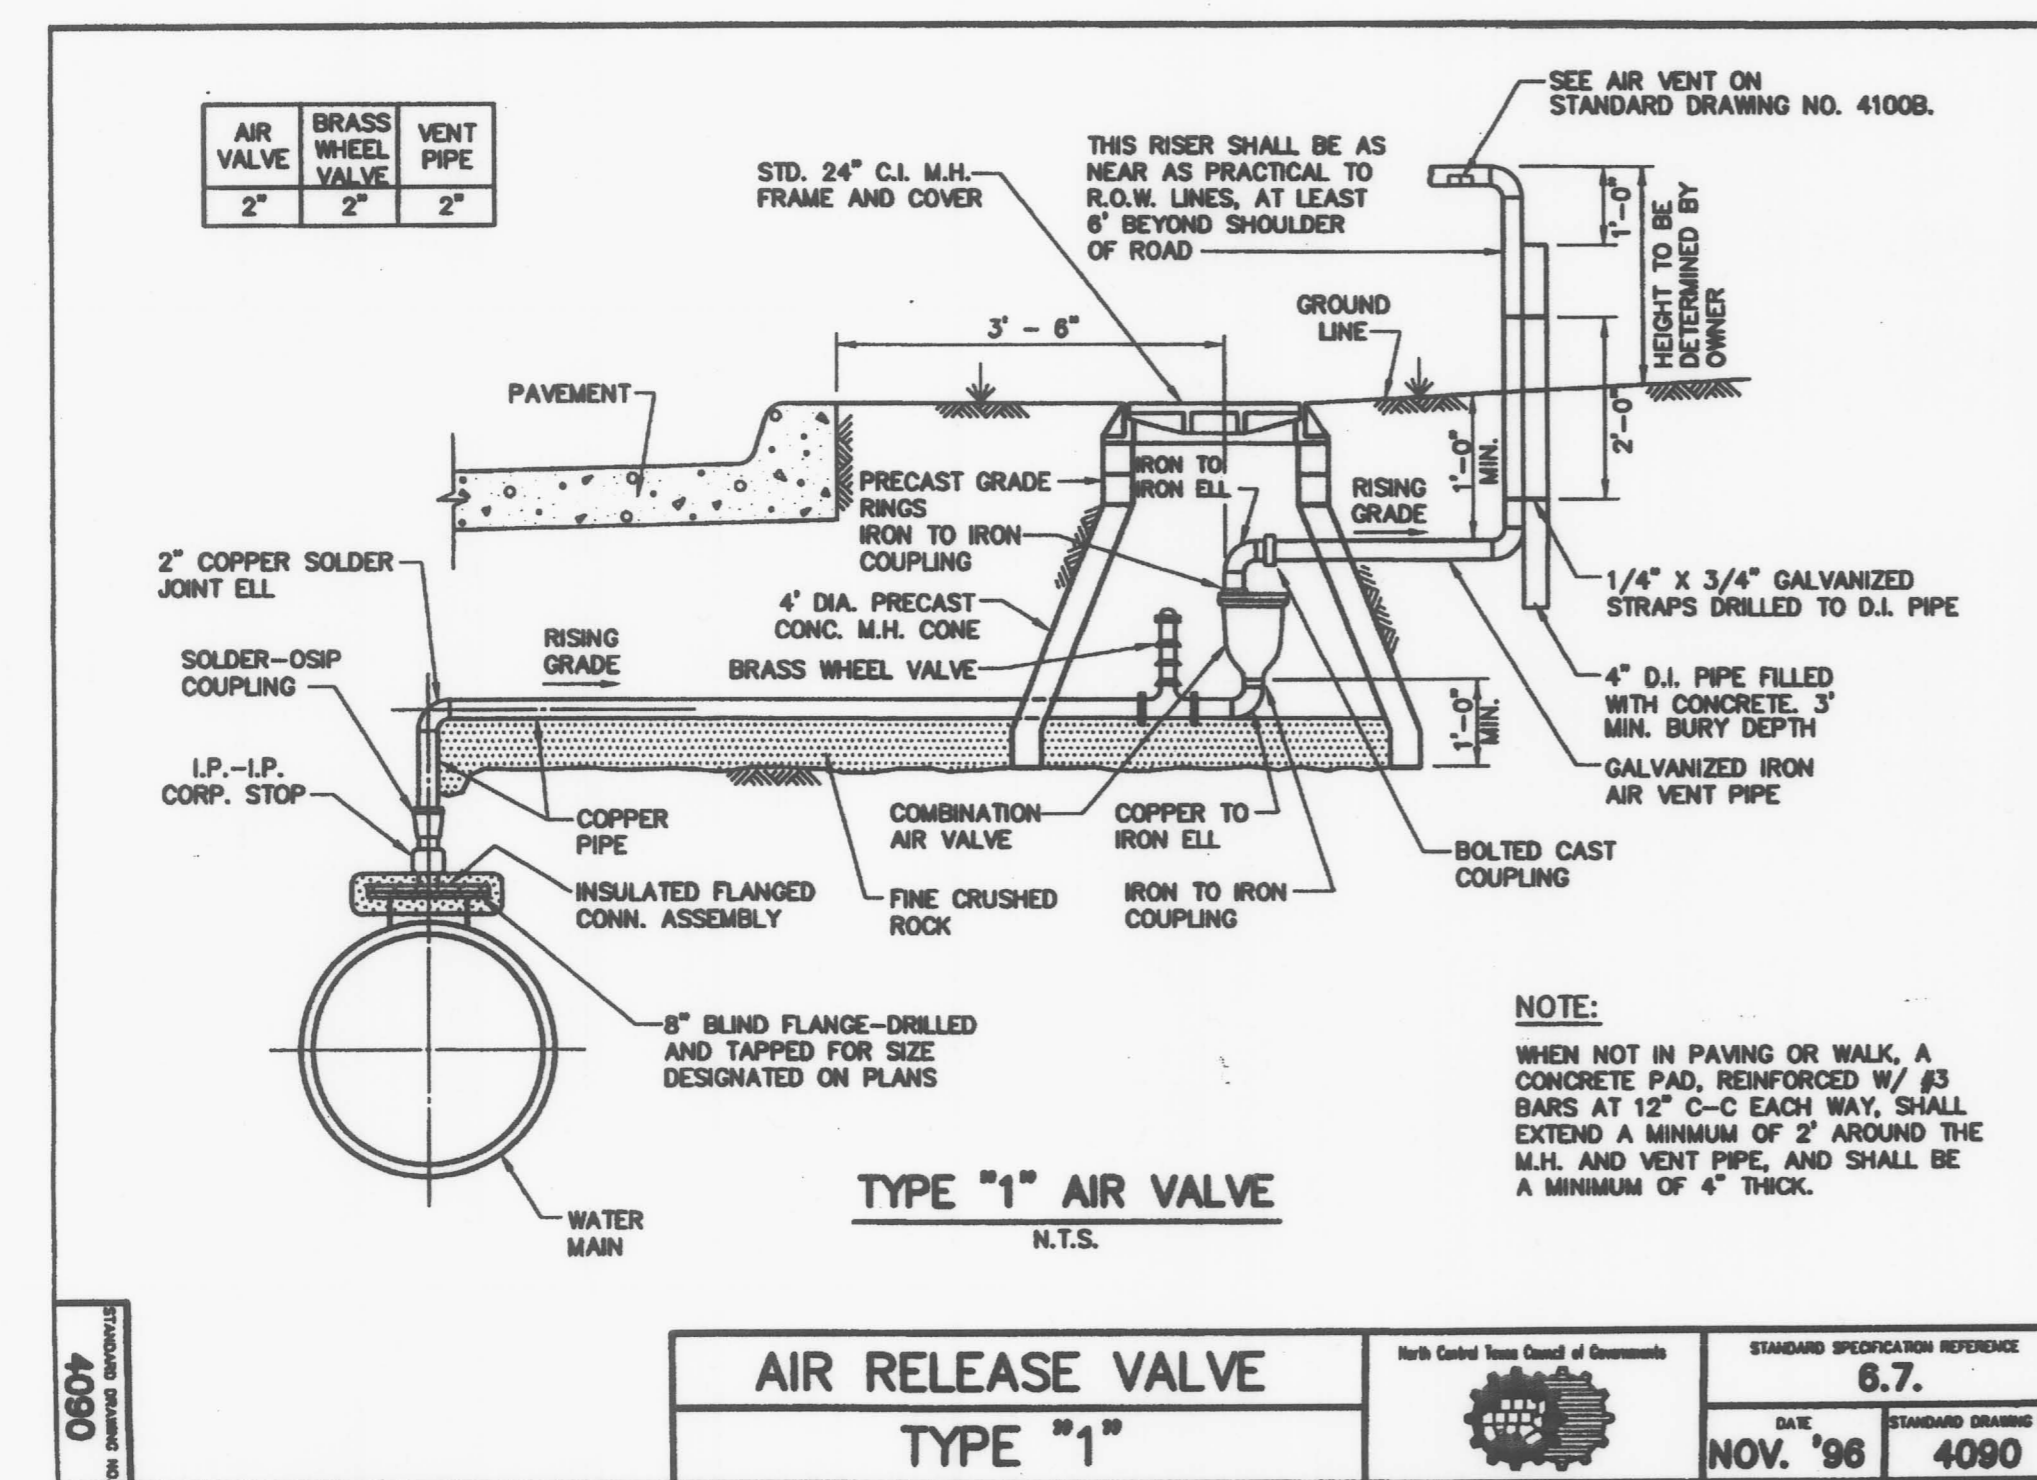


AIR RELEASE VALVE
TYPE "1"
 STANDARD SPECIFICATION REFERENCE: 6.7
 DATE: NOV. '96
 STANDARD DRAWING NO: 4090

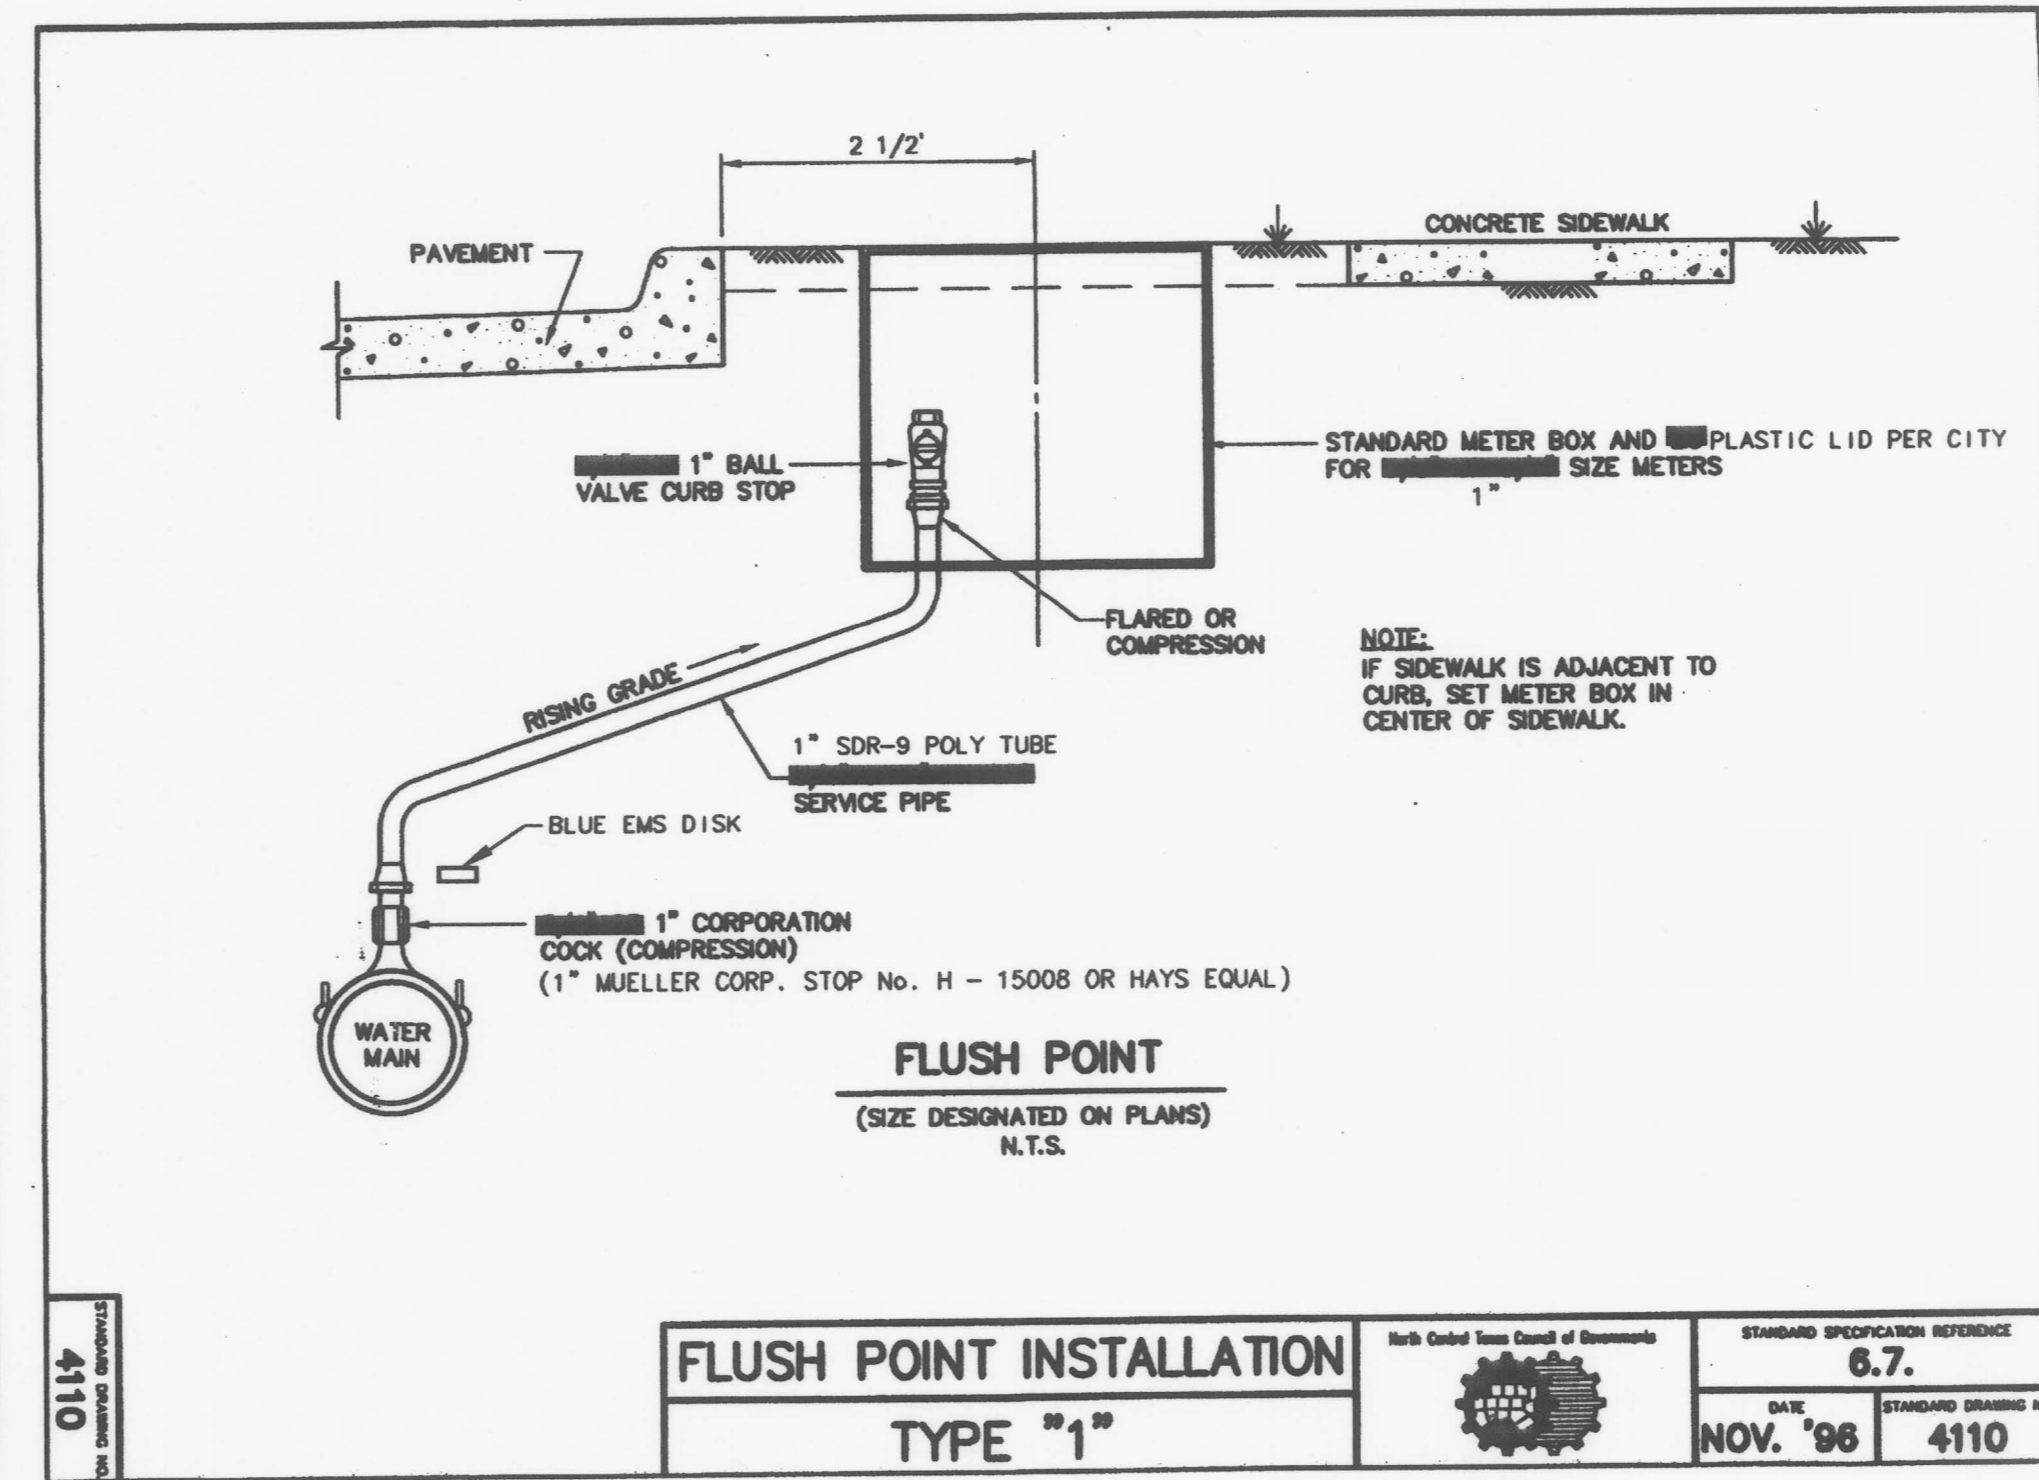

FLUSH POINT INSTALLATION
TYPE "1"
 STANDARD SPECIFICATION REFERENCE: 6.7
 DATE: NOV. '96
 STANDARD DRAWING NO: 4110

DETAILS
 SCALE: AS NOTED

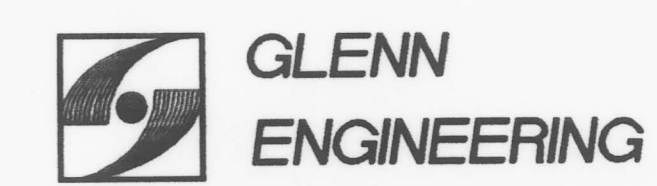

PHONE: 972-717-5151 FAX: 972-719-4229
 100 DECKER COURT - SUITE 250 IRVING, TEXAS 75062

©2002 SHW Group, Inc.