

rockwall,

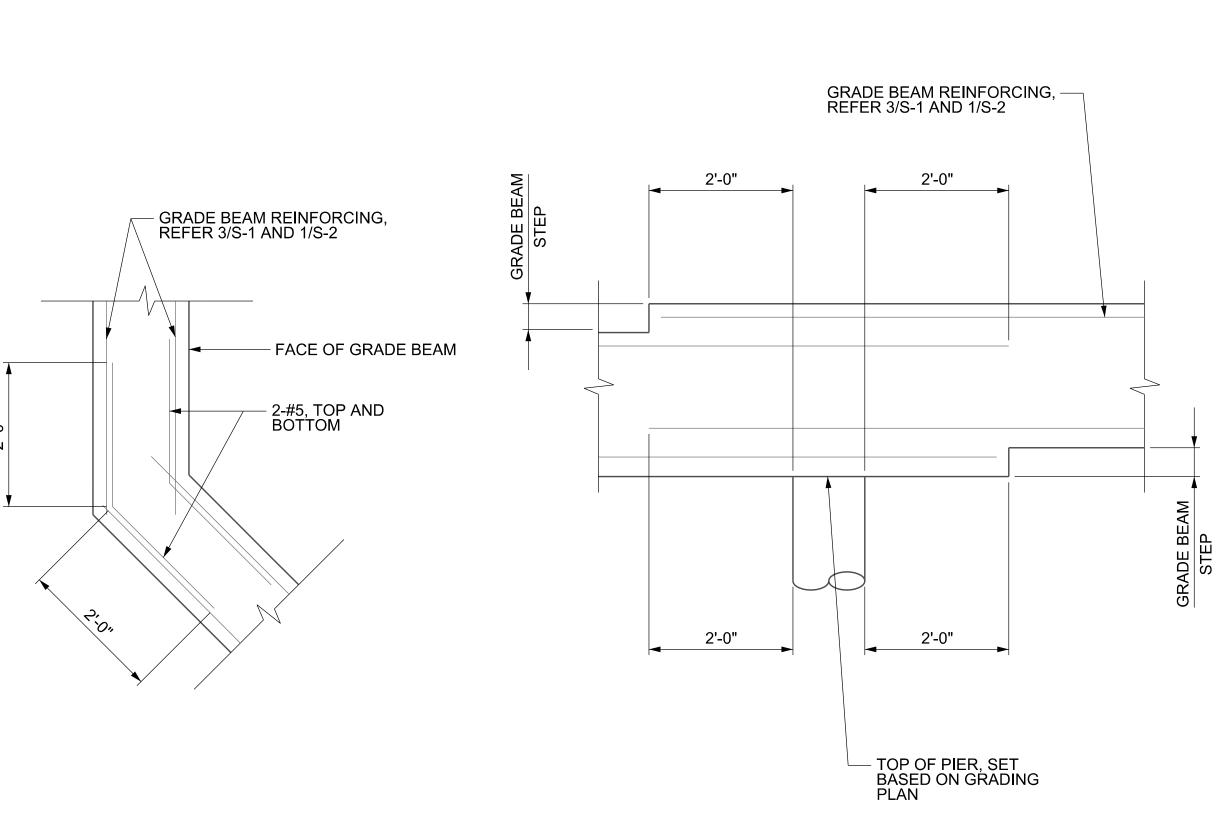

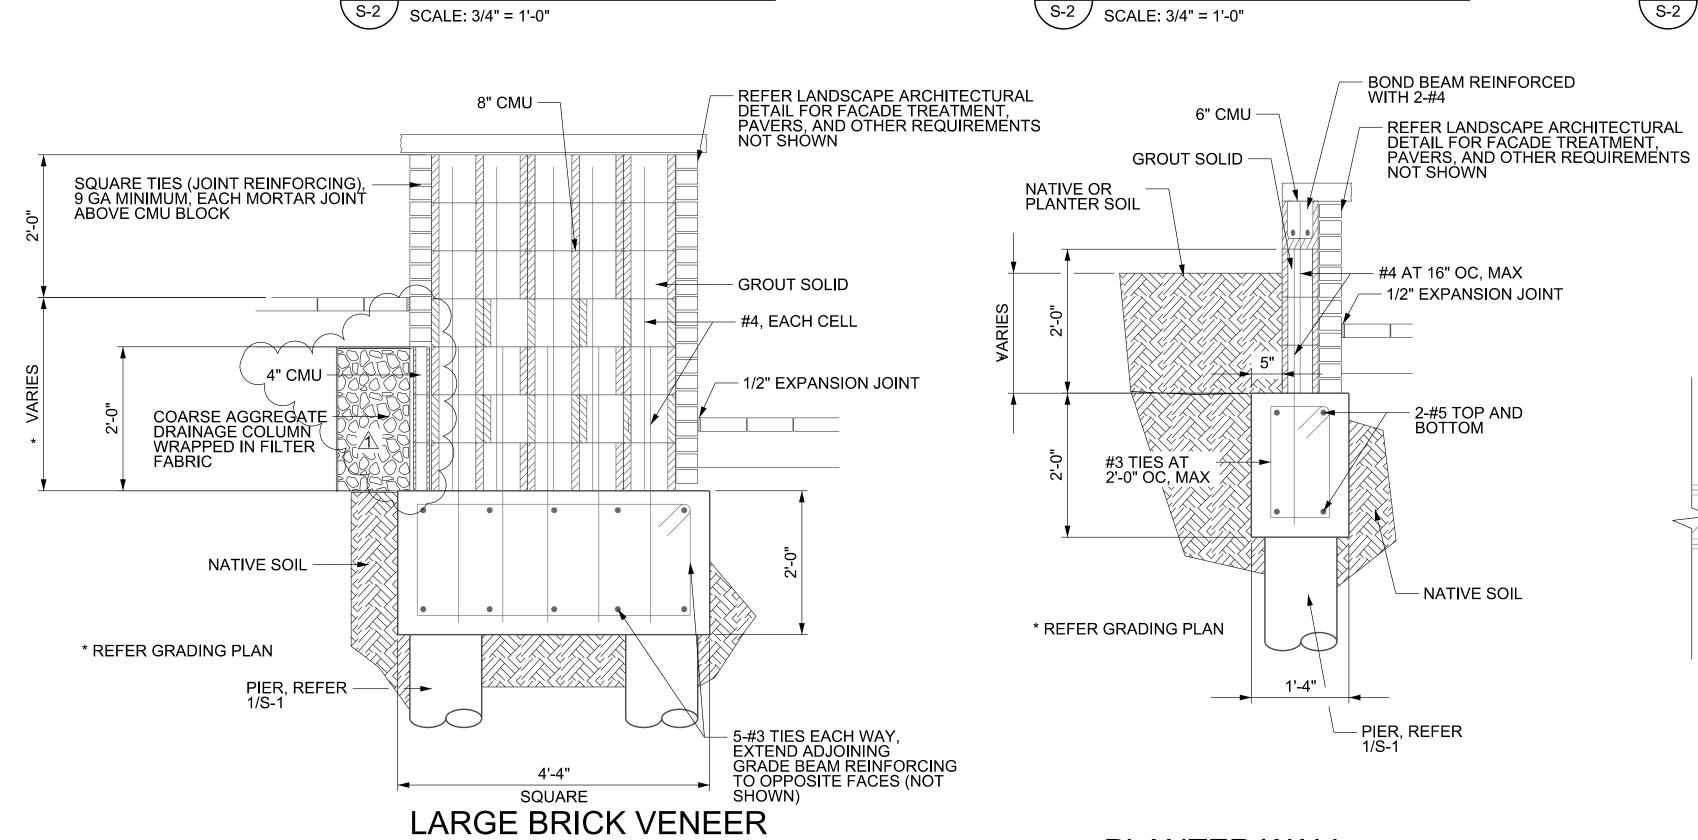

- BOND BEAM REINFORCED WITH 2-#4

- CUT BLOCK AS REQUIRED TO ACHIEVE GRADE, DO NOT CUT BOND BEAM

REFER LANDSCAPE
ARCHITECTURAL
DETAILS FOR FACADE
TREATMENT

- 3" DIA WEEPHOLE SPACED AT 10'-0" OC, MAX, WRAP BACK SIDE WITH FILTER FABRIC

- #3 TIES, SPACE AS SHOWN IN DETAIL 6/S-1

* REFER GRADING PLAN

#5 AT 16" OC

- 2-#5, TOP AND BOTTOM

– DRILLED PIER, REFER 1/S-1

1'-6"

RETAINING WALL

COLUMN

SCALE: 3/4" = 1'-0"

FACE OF GRADE BEAM

GRADE BEAM CORNER

PLANTER WALL

SCALE: 3/4" = 1'-0"

- GRADE BEAM REINFORCING, REFER 3/S-1 AND 1/S-2

2'-0"

2'-0"

2-#5, TOP AND — BOTTOM

- #5 AT 16" OC, MAX

8" CMU —


WATERPROOF PAINT OR SEAL BACK FACE

1'-0" THICK COMPACTED — CLAY CAP

SELECT FILL

COARSE AGGREGATE DRAINAGE COLUMN WRAPPED IN FILTER FABRIC

NATIVE SOIL -

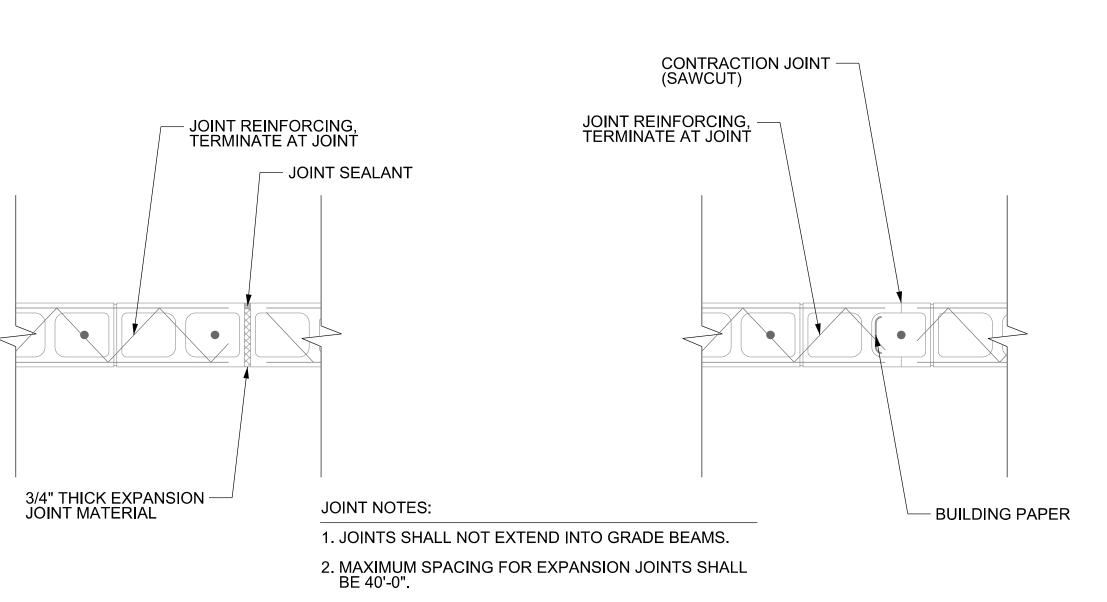

3. MAXIMUM SPACING FOR CONTRACTION JOINTS SHALL BE 20'-0".

EXPANSION JOINT SCALE: 3/4" = 1'-0"

GRADE BEAM BEND

SCALE: 3/4" = 1'-0"

CONTRACTION JOINT SCALE: 3/4" = 1'-0"

 $\sqrt{S-2}$ | SCALE: 3/4" = 1'-0"

FOR PROCUREMENT PURPOSES ONLY PIERCE ENGINEERING

BUS.: (940) 937-8600 132 N. MAIN STREET CHILDRESS, TX 79201

DETAILS

STRUCTURAL

<u>registration</u>