


SCALE 1" = 20'

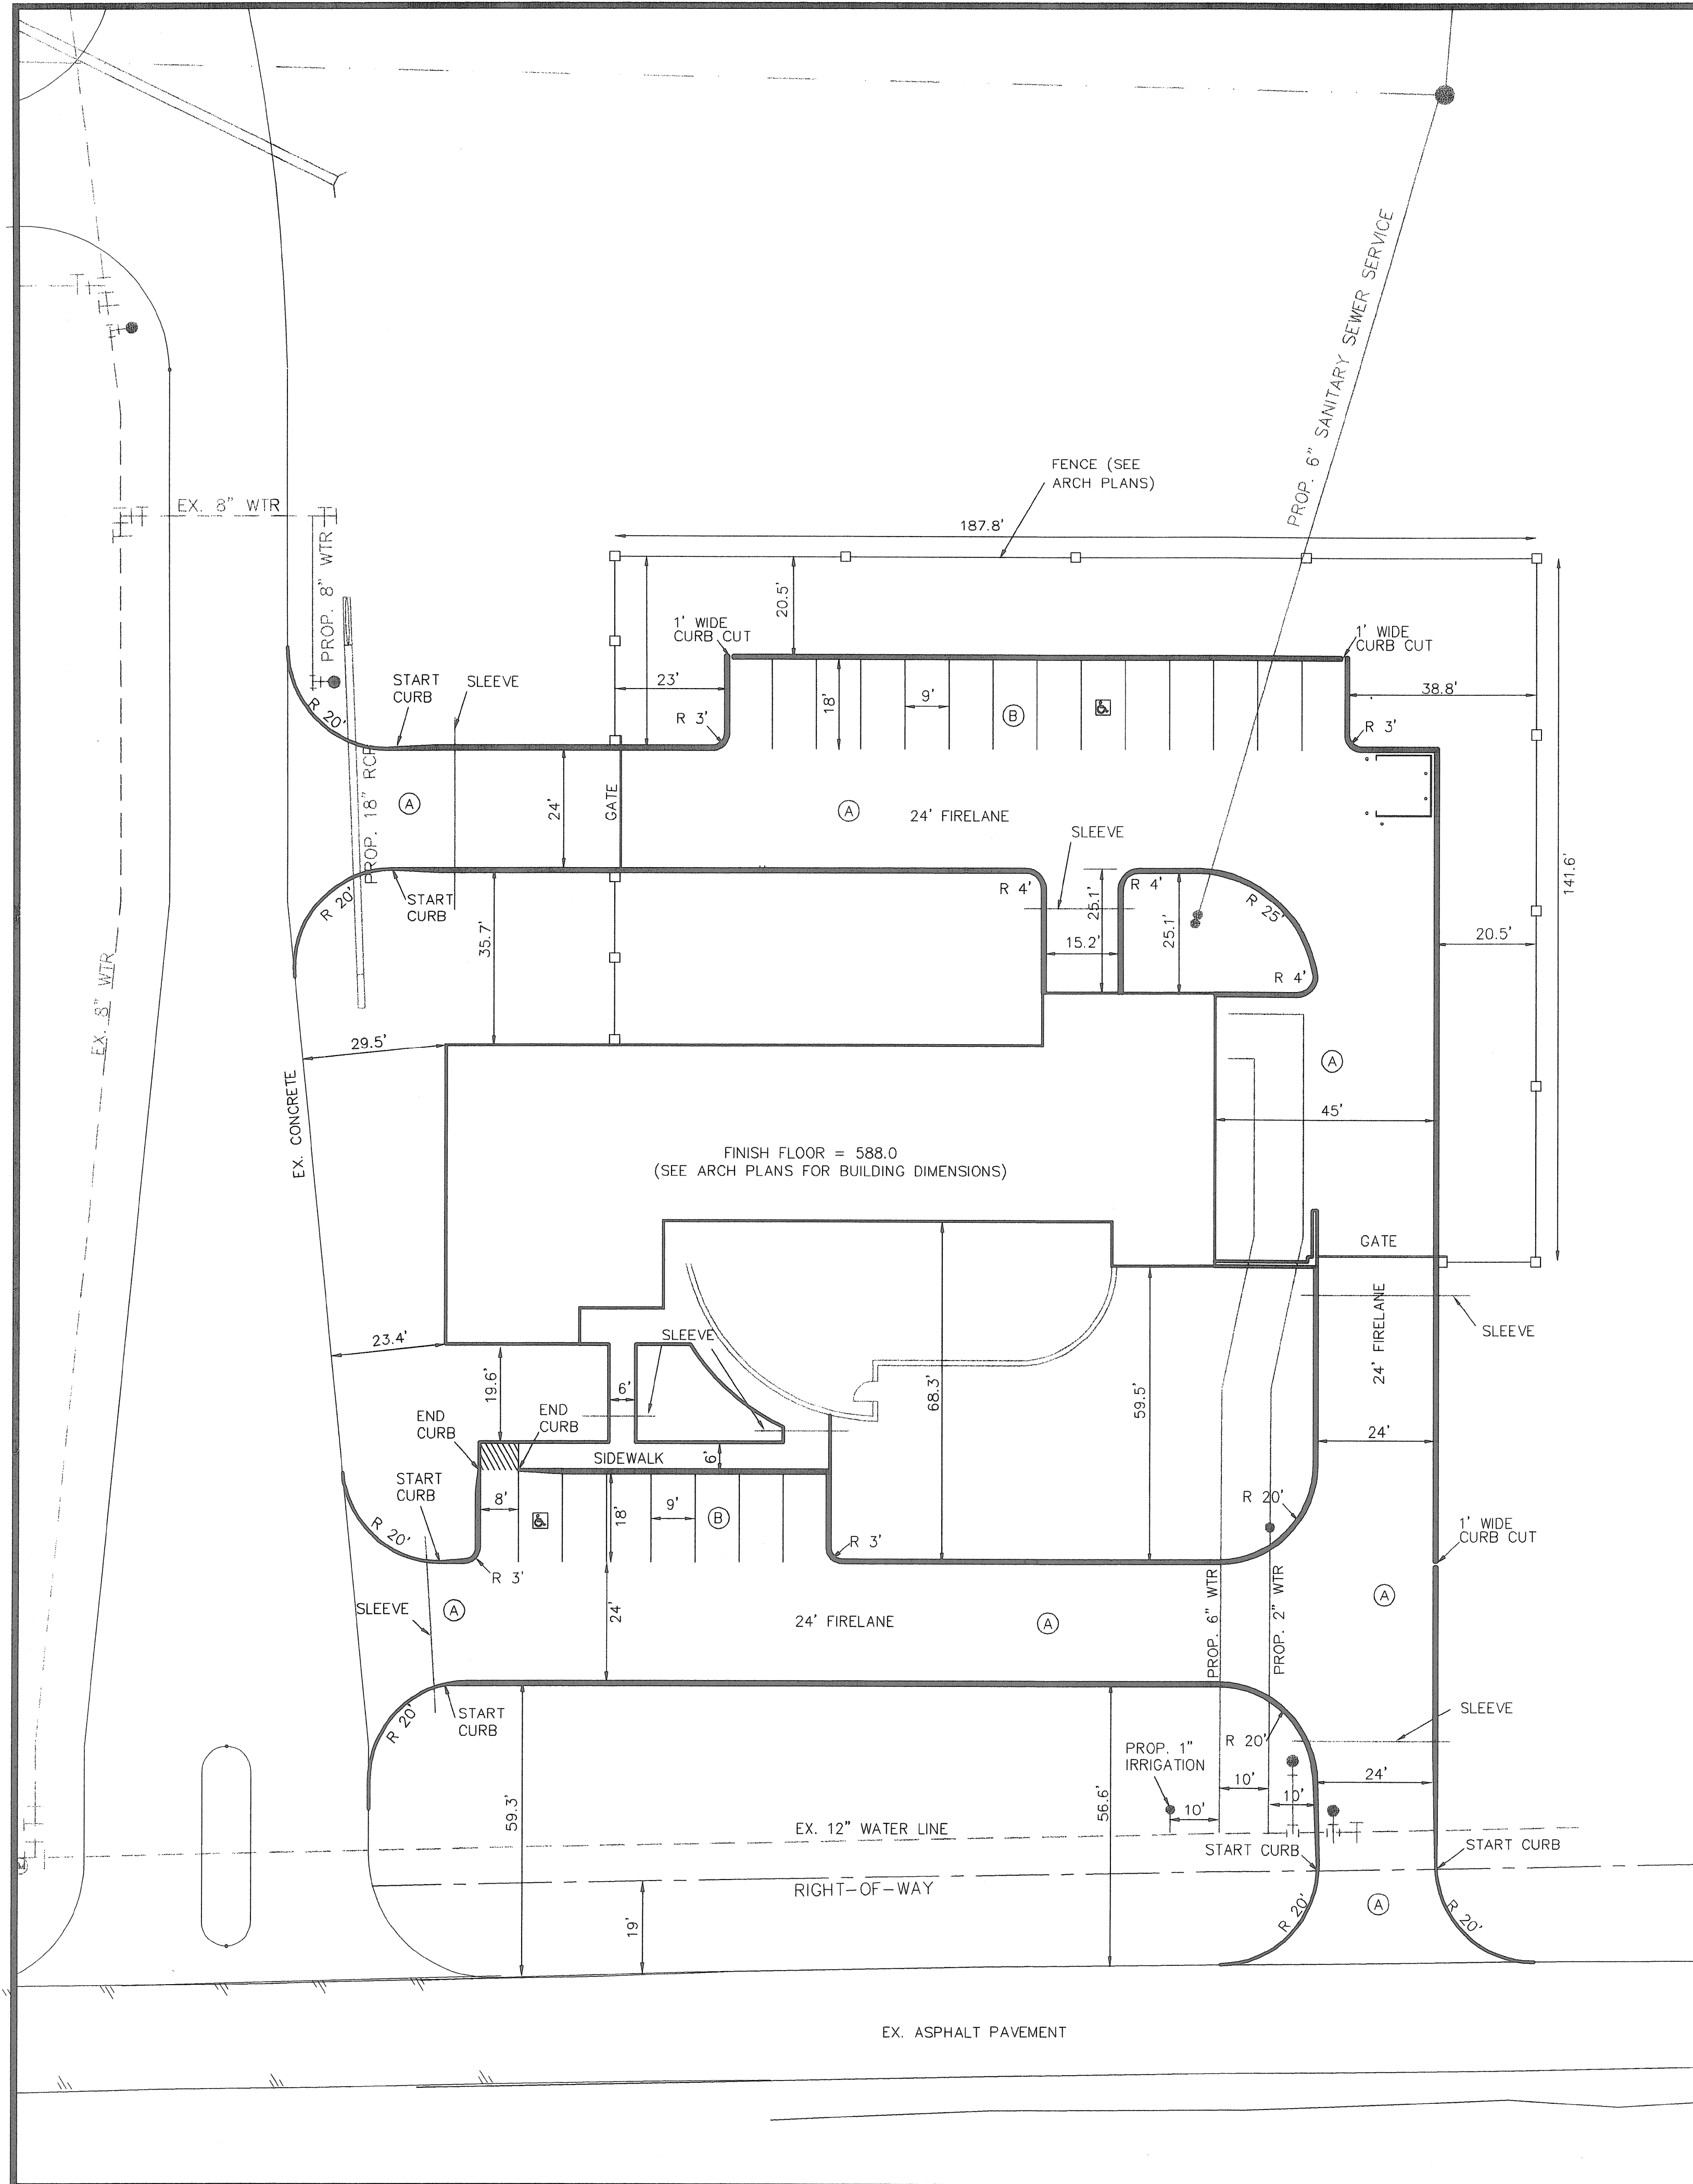

NOTES

- ALL DIMENSIONS ARE FACE OF CURB TO FACE OF CURB
- ALL FILL TO BE COMPACTED TO 95% STD. DENSITY USING A SHEEP'S FOOT ROLLER
- ALL FIRELANES TO BE 6" 3600 PSI CONCRETE (MIN 6 SACK FOR MACHINE PLACE AND MIN 6.5 SACK FOR HAND PLACE)
- USE NORTH CENTRAL TEXAS COUNCIL OF GOVERNMENT 3RD EDITION AND CITY OF ROCKWALL STANDARDS AND SPECIFICATIONS
- CONTRACTOR IS RESPONSIBLE FOR LOCATING ALL EXISTING UTILITIES PRIOR TO CONSTRUCTION AND IF ANY DISCREPANCIES OCCUR NOTIFY THE ENGINEER IMMEDIATELY
- CONTRACTOR IS RESPONSIBLE FOR REPAIRING AND/OR REPLACING ANY EXISTING UTILITIES THAT ARE DAMAGED DURING CONSTRUCTION. ALSO ALL EXISTING UTILITIES WITH ELEVATION CHANGES WILL NEED TO BE ADJUSTED BY THE CONTRACTOR.


PAVING SPECIFICATIONS

- (A) DRIVE/FIRELANE
6"-3600 PSI CONCRETE
NO. 3 @ 18" CENTERS
6" LIME SUBGRADE:
LIME @ 32LBS/SY
- (B) PARKING SPACES AND SIDEWALK
5"-3600 PSI CONCRETE
NO. 3 @ 18" CENTERS
6" LIME SUBGRADE:
LIME @ 32LBS/SY

DIMENSIONAL CONTROL
 ROCKWALL ANIMAL ADOPTION CENTER
ROCKWALL, TEXAS
CITY OF ROCKWALL
 "THE NEW HORIZON"

REVISION NO.	REMARKS	DATE

DESIGNED: A.J.W.	THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY CHARLES A. TODD TEXAS P.E. NO. 55647
DRAWN: LD2006	
JOB NO. DIMENSIONS.DWG	
DATE: 03/2007	C1

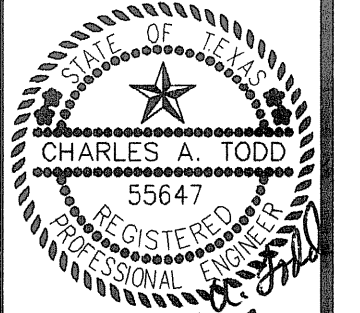

Charles A. Todd
3/2007