

1 SITE PLAN  
1"=5'


FMI PROJECT #  
15023




THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY VICTOR L. ACUY, P.E. NO. 114152 ON 06.09.16

**FREEMAN-MILLICAN, INC.**  
ENGINEERS - ARCHITECTS - PLANNERS  
NORTH KERRVILLE ROAD 12400, SUITE 200, DALLAS, TX 75243 (214) 603-0555 (FAX) (214) 603-1487  
TX REG. ENGR. #1904 P-2827


- NOTE**
1. GENERATOR PAD DIMENSIONS TO BE DETERMINED BY GENERATOR MANUFACTURER
  2. THE LOCATION OF EXISTING UTILITIES AND STRUCTURES HEREIN IS APPROXIMATE. THE CONTRACTOR SHALL VERIFY LOCATION OF ALL EXISTING UTILITIES PRIOR TO CONSTRUCTION.
  3. GRADE SITE TO DRAIN

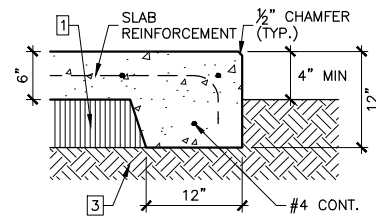

SECTION 1  
1"=1'-0"

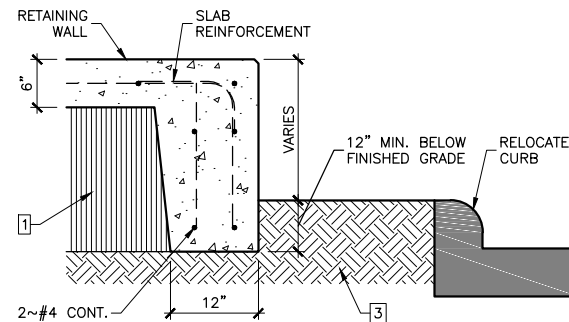

SECTION 2  
1"=1'-0"

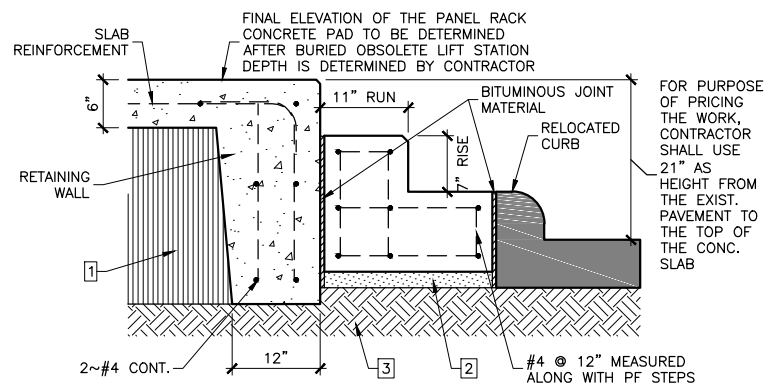


SECTION 3  
1"=1'-0"


- LEGEND**
1. GRANULAR MATERIAL COMPACTED TO 95% STD. PROCTOR DENSITY @ 2-4% ABOVE OPTIMUM MOISTURE.
  2. 2" SAND CUSHION
  3. 6" NATIVE SUBGRADE SCARIFIED AND RECOMPACTED

- NOTE**
1. REINFORCED CONCRETE SHALL BE 4,000 PSI
  2. REINFORCEMENT SHALL BE #4 @ 12" O.C., EW, UNLESS OTHERWISE NOTED IN DRAWINGS
  3. GRADE SITE TO DRAIN
  4. RETAINING WALL HEIGHT ON SOUTH SIDE OF SLAB VARIES. FIELD VERIFY ELEVATIONS AND ADJUST ACCORDINGLY.


2 CONTROL PANEL SLAB  
1"=1'-0"

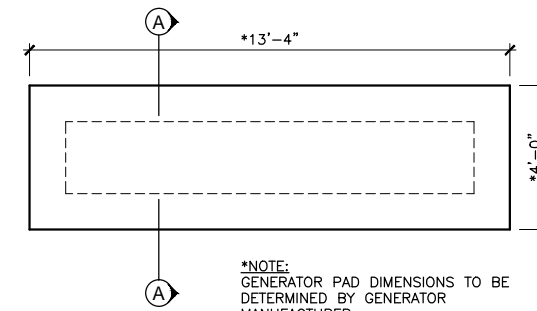


PLAN VIEW  
3/8"=1'-0"

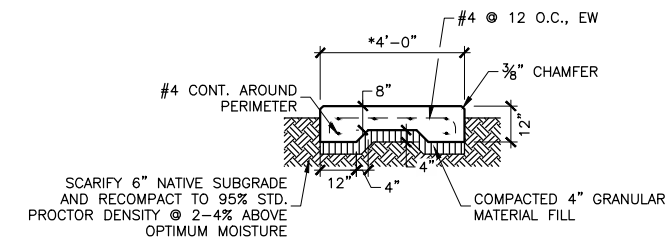

3 GENERATOR PAD SECTION  
3/8"=1'-0"

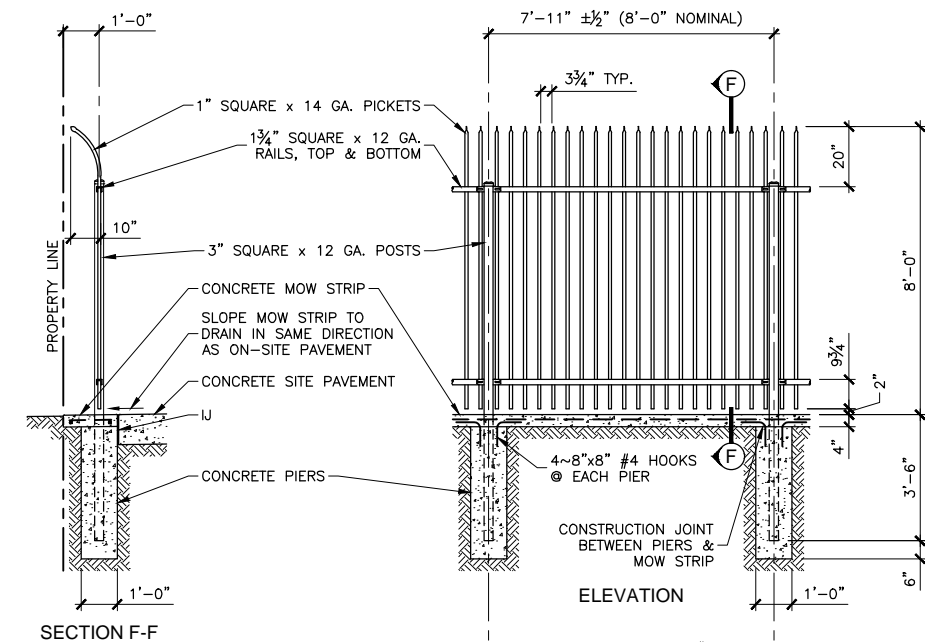

SECTION F-F

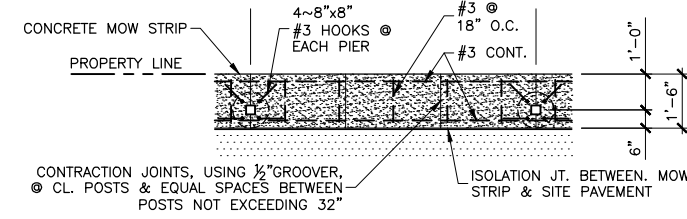

4 STEEL PICKET FENCE  
1/4"=1'-0"