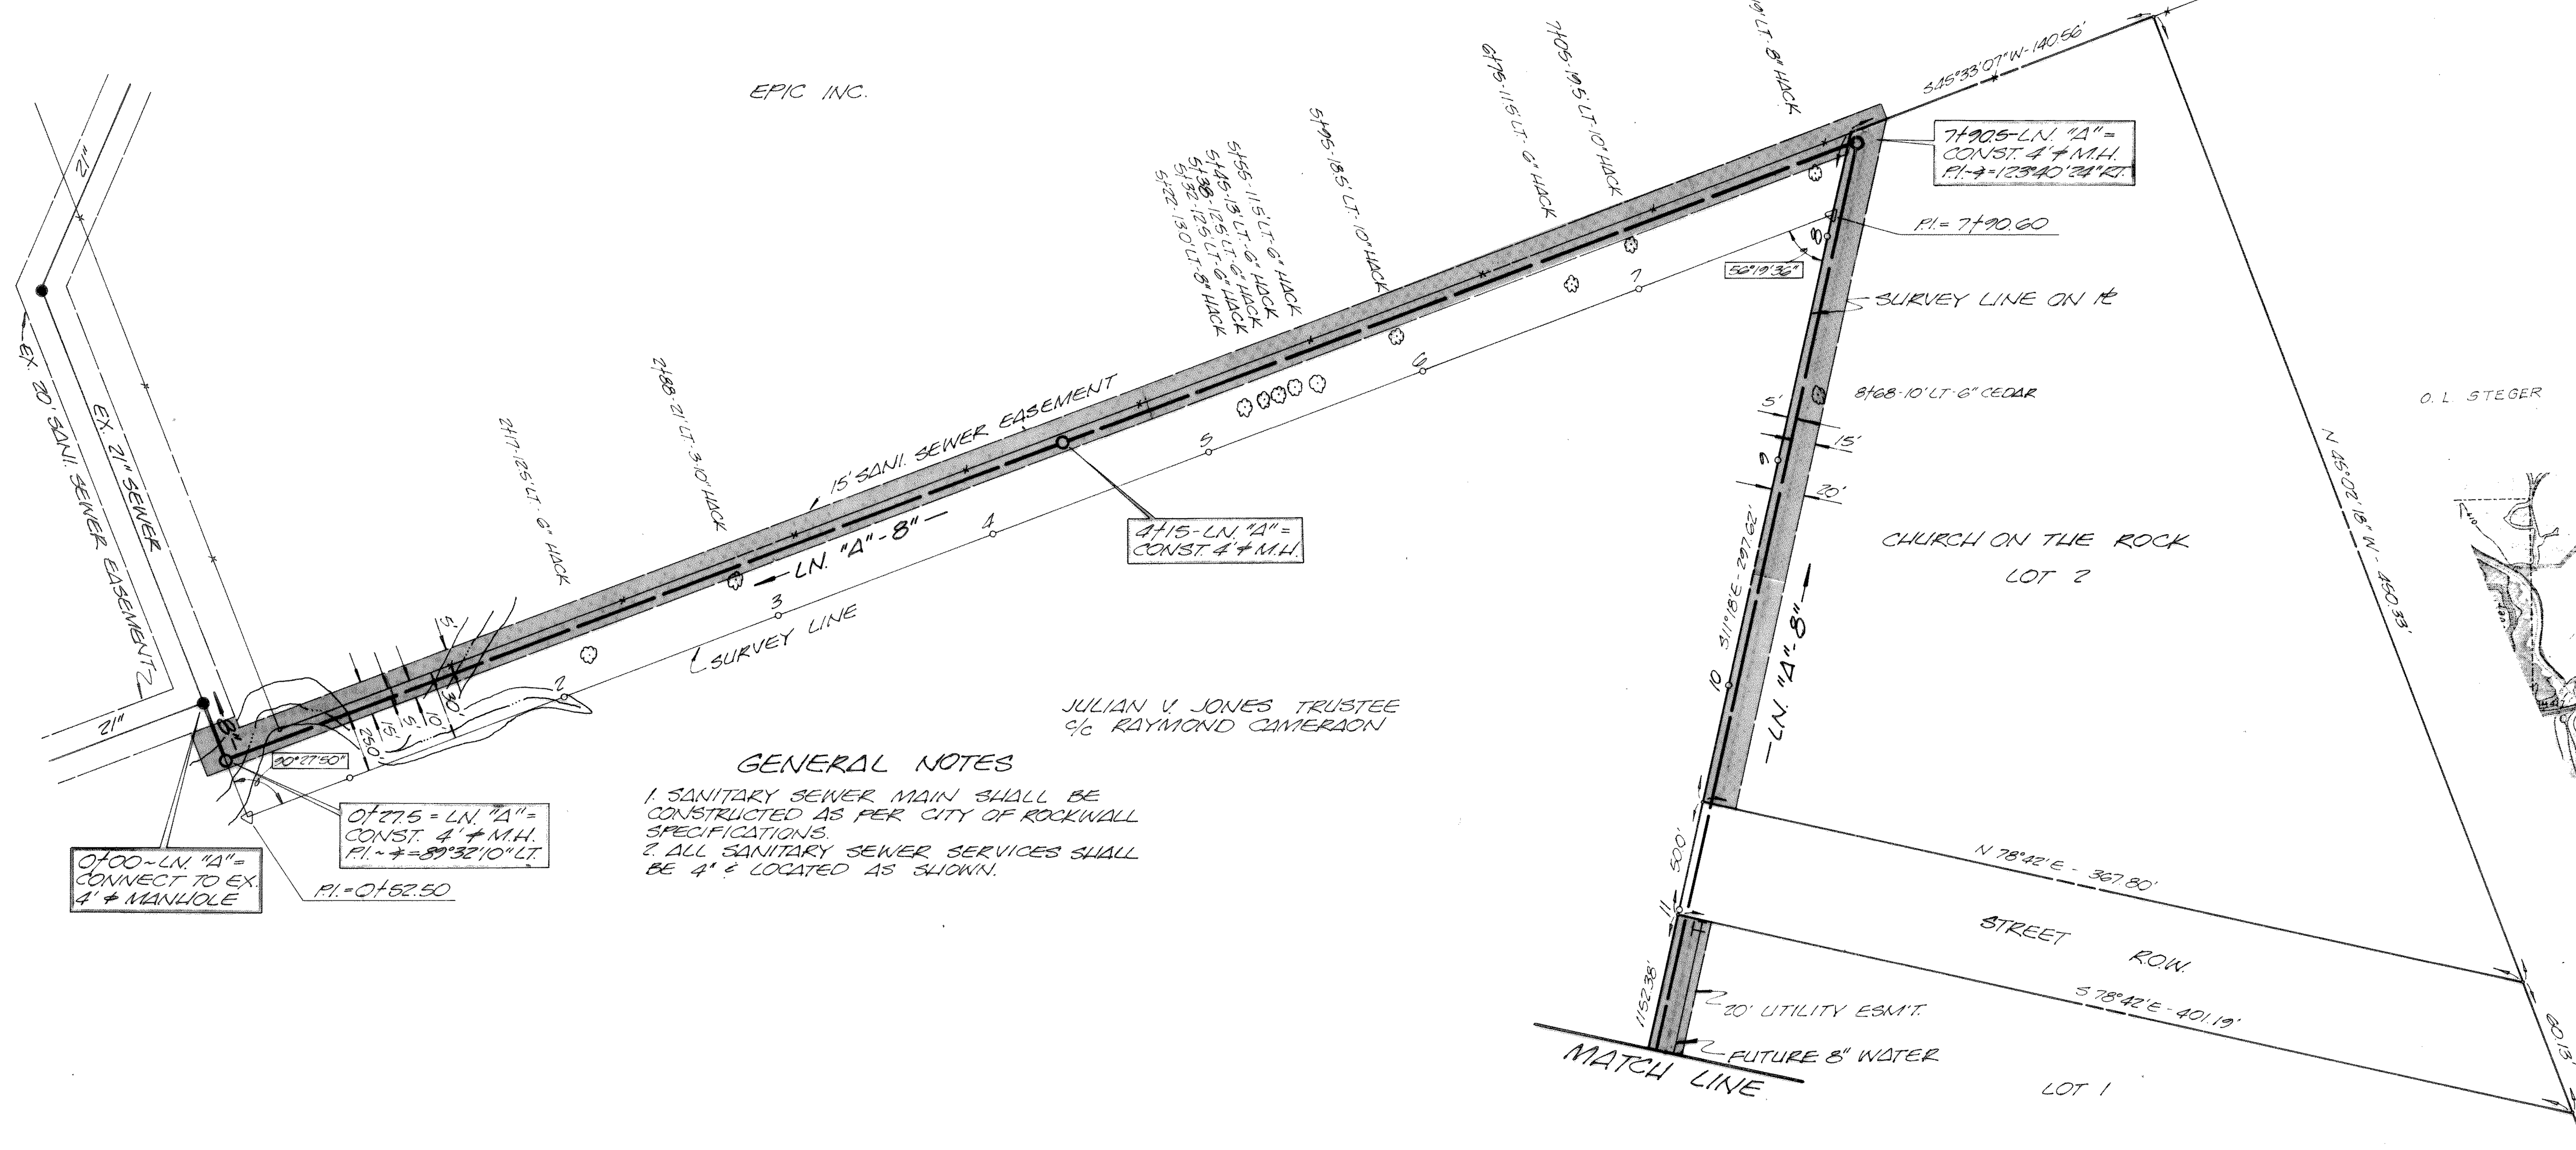

GENERAL NOTES

1. SANITARY SEWER MAIN SHALL BE CONSTRUCTED AS PER CITY OF ROCKWALL SPECIFICATIONS.
2. ALL SANITARY SEWER SERVICES SHALL BE 4" ⌀ LOCATED AS SHOWN.

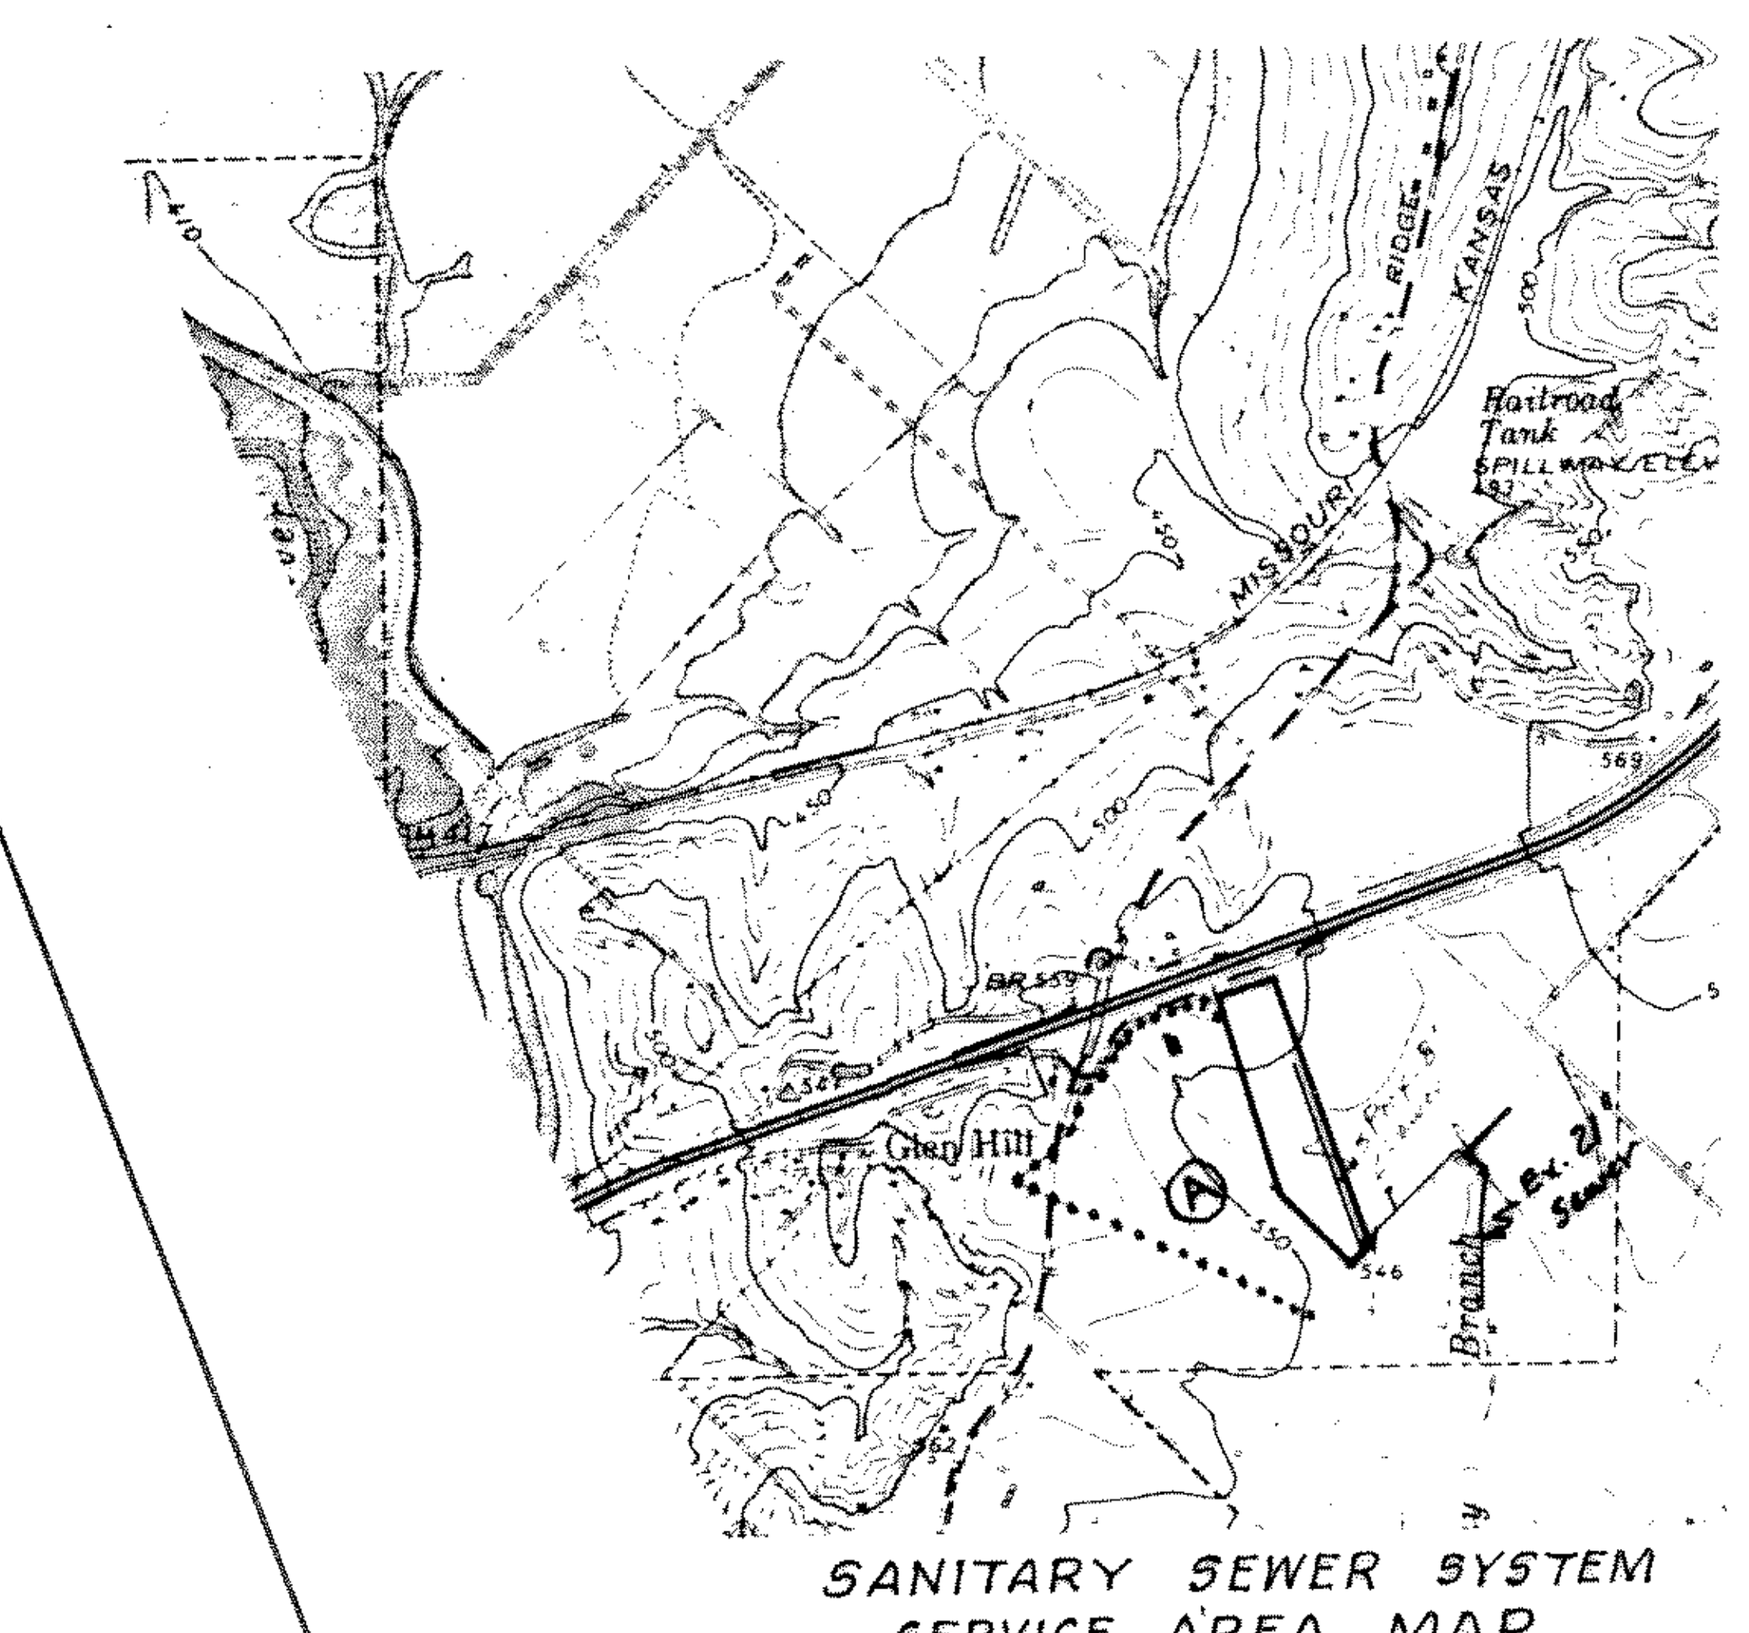

SANITARY SEWER SYSTEM
SERVICE AREA MAP

Area Ⓐ 48 Ac. x 10 persons/Ac. (avg.) x 200 gal./person x 200% (peak) = 192,000 gal./day = 0.30 c.f.s.
Pipe Design 8" on 0.40% = 0.78 c.f.s. capacity.

NOTE:

It is the responsibility of the Contractor to notify all utility companies and verify all existing utilities prior to the start of construction.

SANITARY SEWER MAIN

ROCKWALL CHURCH ON THE ROCK INC.

WATER UTILITIES DEPT.

CITY OF ROCKWALL, TEXAS

DESIGN	DRAWN	DATE	SCALE	NOTES	FILE	NO.
D.A.T.	D.A.T.	2-81	1"=40' H. 1"=6' V.	D.A.T.	Rockwall Surveys	3/4

#1303