


(ROADWAY W/O CURB)

CONCRETE SIDEWALK DETAILS

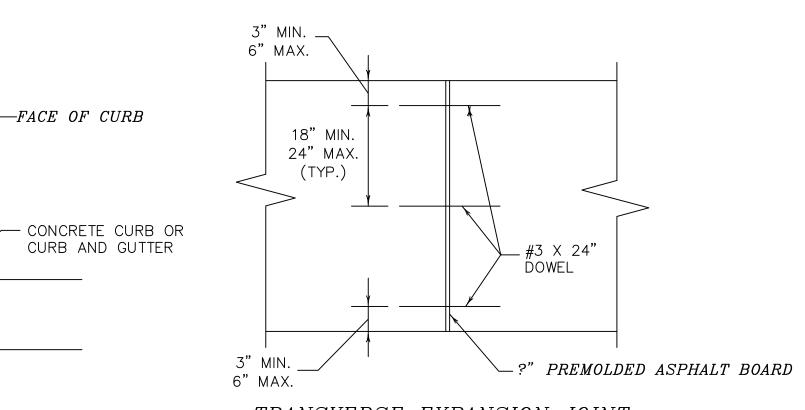

JOINT SEALING COMPOUND (CL. 3, 4, 5, OR 7)

—FACE OF CURB

TRANSVERSE EXPANSION JOINT

SEE PLAN SHEETS FOR LOCATIONS OF SIDEWALKS AND RETAINING WALLS.

SIDEWALK WIDTH + 4"


REINFORCING STEEL DETAIL

LONGITUDINAL SLOPE OF SIDEWALKS SHALL NOT EXCEED 5% EXCEPT IN CASES WHERE THE ADJACENT ROADWAY SLOPE EXCEEDS 5%. IF ROADWAY SLOPE EXCEEDS 5%, LONGITUDINAL SLOPE OF SIDEWALK MAY MATCH THAT OF ROADWAY.

IF SIDEWALK WIDTH IS LESS THAN 5', PROVIDE 5' x 5' PASSING AREAS AT INTERVALS NOT TO EXCEED 200' SPACING.

WHERE SIDEWALK WITH RETAINING WALL IS SPECIFIED, RETAINING WALL WILL BE SUBSIDIARY TO THE ITEM, "CONCRETE SIDEWALK (SPECIAL) (RETAINING WALL)", WITH LIMITS OF PAY AS SHOWN HEREON.

SURFACE TREATMENT OF RETAINING WALL FACE DETAILED ELSEWHERE IN THE PLANS.

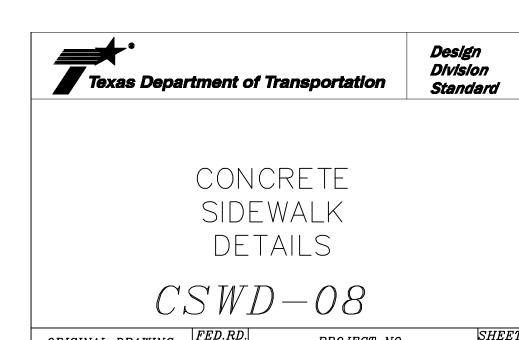

ORIGINAL DRAWING PROJECT NO. JUNE 2008 STATE DIST. COUNTYTEXAS CONT. | SECT. | JOB HIGHWAY NO.

© 2008 by Texas Department of Transportation; all rights reserved