

INSTALL: 4- 6" D.I. GUARD POST ANCHORED AND FILLED WITH CONCRETE SPACED 5' -0" APART (EQUAL DISTANCE FROM THE FIRE HYDRANT) MINIMUM HEIGHT EQUAL TO FIRE HYDRANT.

POST TO BE A MINIMUM OF 3' BELOW FINISHED PAVEMENT GRADE.

POST SHALL BE PAINTED YELLOW.

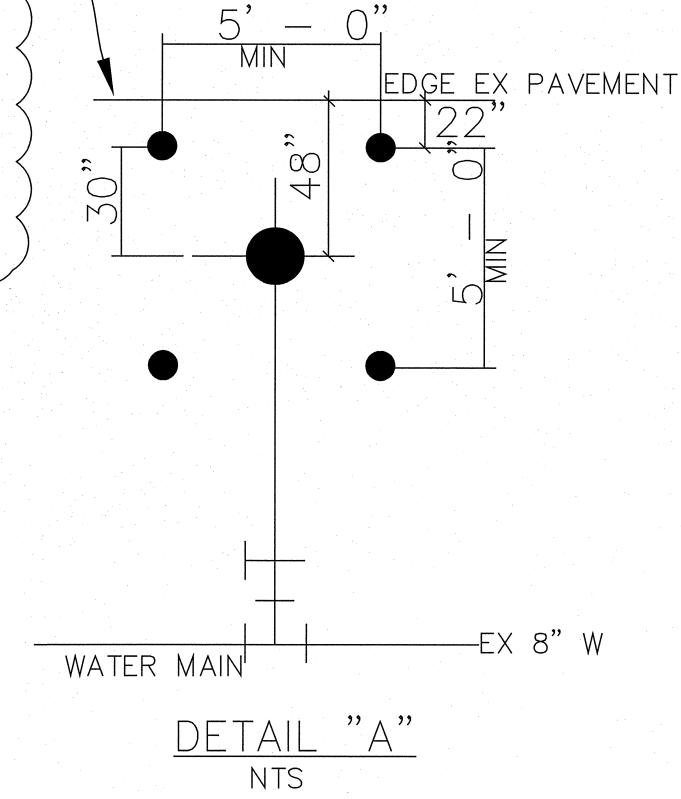

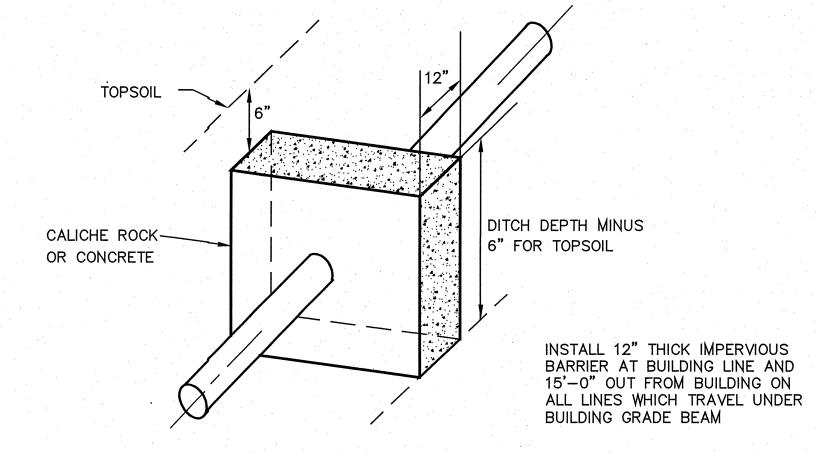

IMPERVIOUS BARRIER



CIVIL: GLENN ENGINEERING, INC.


STRUCTURAL: SHW GROUP LLP


ESTES, McCLURE & ASSOCIATES

LANDSCAPING: RAMSEY LANDSCAPE ARCHITECTS

FOOD SERVICE: JMK DESIGNS

FINAL PLANS FOR PERMITTING AND CONSTRUCTION



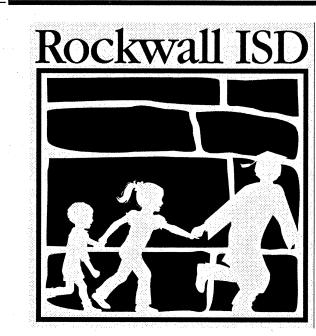

ROCKWALL HIGH SCHOOL ROCKWALL, TEXAS

CHECKED:

© 2008 SHW Group LLP

5/27/2008

1 ADDENDA #1 - MARCH 17, 2008 2 ADDENDA #2 - MARCH 25, 2008

3 ADDENDA #3 - APRIL 1, 2008

4 CITY REVIEW COMMENTS - APRIL 22, 2008 5 CITY REVIEW COMMENTS - SEPT. 09, 2008

6 RECORD SET - MARCH 04, 2009

7 REVISED RECORD SET - JUNE 04, 2009

Sheet Title: WATER

DETAILS

RECORD DRAWING This is to certify that changes and corrections have been made to conform to the contractor's record of this project. Glenn Engineering Corporation